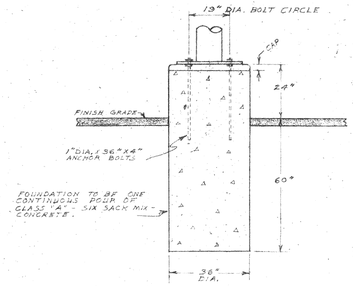

FOUNDATION DETAIL

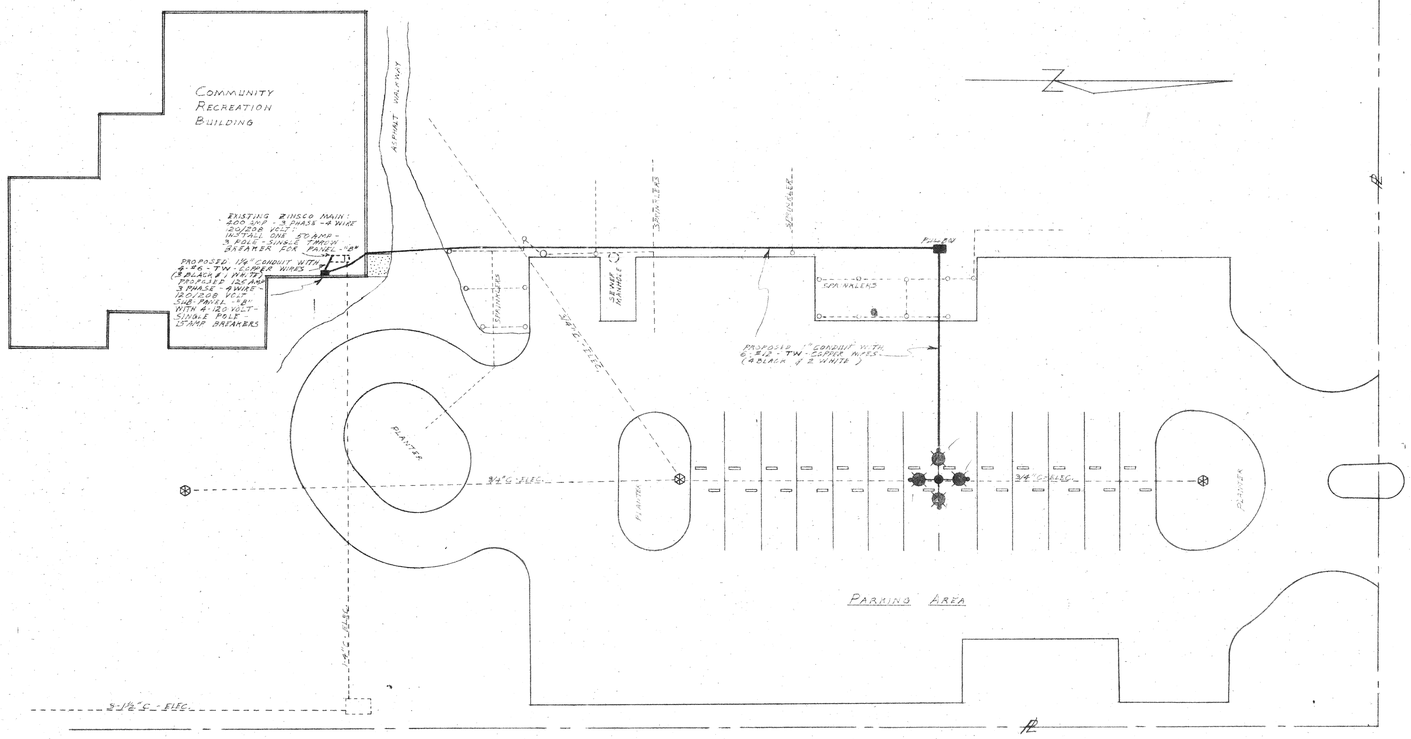



SITE PLAN NTS

LEGEND

Indicates Pacific Union Metal Co. Steel Standard #30FA735BBBB1-8 with quadruple arm construction and 4-1000 watt mercury vapor luminaires with individual photoelectric receptacle and control unit.

Indicates a No. 3½ pullbox "Brooks Products Inc.".

Indicates rigid galvanized steel conduit, size as shown.

Indicates existing post top light standard and luminaire.

Indicates existing facilities - type as noted.

See attached bid sheets (2) for City of Riverside furnished and contractor installed materials; and contractor furnished and installed materials.

NOTES

1. Contractor shall obtain an electrical permit from the Public Works Building Division, permit fees will not be required.
2. All phases of construction shall be inspected by the Public Works Building Division.
3. All construction shall comply to the National Electric Code, Uniform Wiring Code, and Public Utilities Street Light Specification No. 119.
4. Contractor shall contact Public Utilities Department for routing of conduit within the building. Weatherproof condulets shall be installed where required by the engineer.
5. All wire shall be 600 Volt-TW-Copper, size and color coded as noted.
6. Underground conduits shall be placed by boring at a minimum depth of 18 inches, and bonded in accordance with specification No. 119.
7. Backfill and compaction shall be as specified in specification No. 119.
8. Each luminaire shall operate at 120 volts and be protected by a 15 amp-single-pole breaker in panel-"B".
9. The 50 amp sub-main breaker and the 125 amp sub-panel shall both be labeled "Panel-B".
10. See Drwg. L1-13003 for pullbox installation.
11. Contractor to pick-up City furnished materials at 8095 Lincoln Ave., coordinate with Mr. Erby Davidson, Phone: 787-7471.

BORDWELL PARK - PARKING LOT LIGHTING INSTALLATION:
FENNSYLVANIA AVE. E/O KANSAS AVE.

SCALE 1"=20'	DRAWN WEH	CITY OF RIVERSIDE	
DATE 5-21-63	CHECKED	DEPARTMENT OF PUBLIC UTILITIES	
JOB No	APPROVED	ELEC. DIV.	DRAWING NO. L5-0804
F. B. No	PARKS DEPT. ACCT. NO. 01-532-463		

APPRVD | REVISIONS | DATE