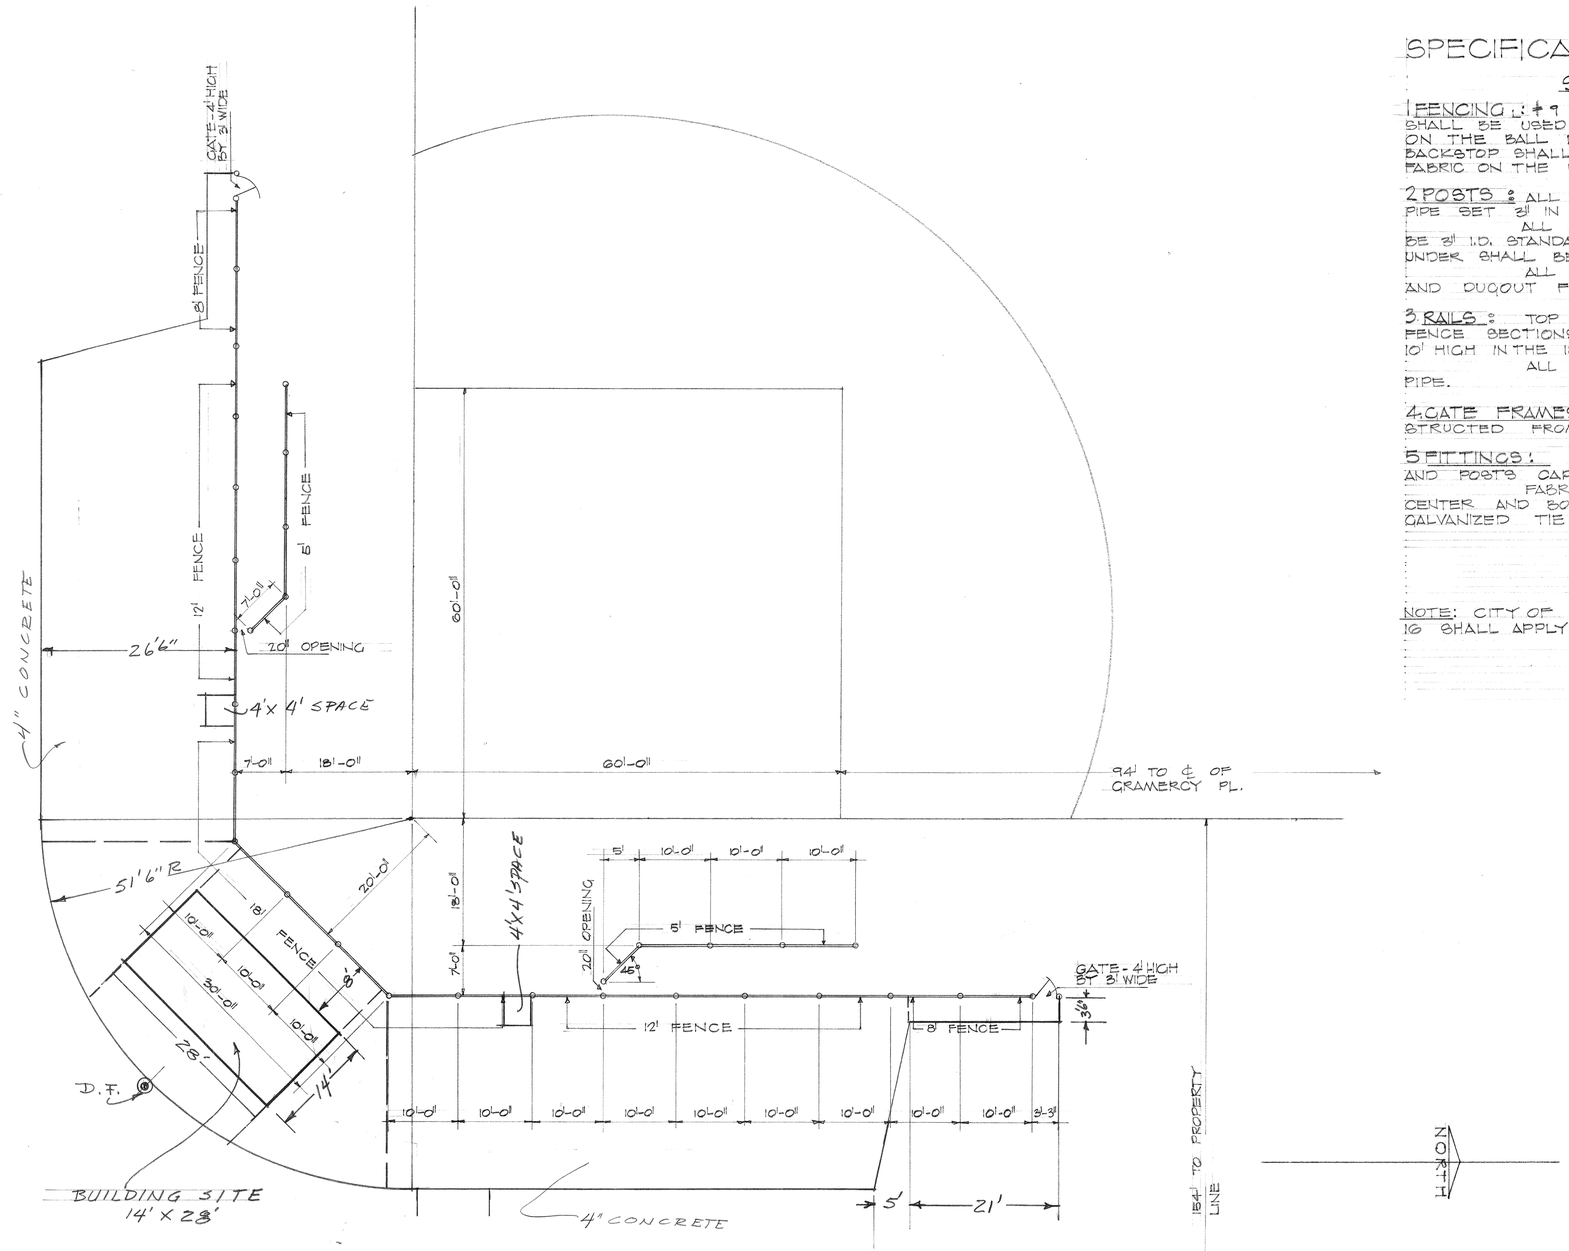

SPECIFICATIONS

SPECIAL CONDITIONS:

1 FENCING: #9 GUAGE, 2 1/4" MESH GALVANIZED CHAIN LINK FENCING SHALL BE USED THROUGHOUT. ALL FENCING SHALL BE INSTALLED ON THE BALL DIAMOND SIDE OF THE POSTS. THE 18' SECTION OF THE BACKSTOP SHALL BE 10' FABRIC ON THE LOWER PORTION AND 8' FABRIC ON THE UPPER PORTION

2 POSTS: ALL 18' POSTS SHALL BE 3" I.D. STANDARD GALVANIZED PIPE SET 3' IN GROUND IN CONCRETE.

ALL END POSTS, CORNER POSTS, AND GATE POSTS SHALL BE 3" I.D. STANDARD GALVANIZED PIPE, AND ALL LINE POSTS 12' AND UNDER SHALL BE 2" I.D. STANDARD GALVANIZED PIPE SET IN CONCRETE.

ALL POSTS SHALL BE SET 10' O.C. EXCEPT GATE POSTS AND DUGOUT FENCE POSTS.

3 RAILS: TOP AND BOTTOM RAILS SHALL BE INSTALLED ON ALL FENCE SECTIONS AND A CENTER RAIL SHALL BE INSTALLED AT 10' HIGH IN THE 18' SECTION OF THE BACKSTOP.

ALL RAILS SHALL BE 1 1/2" I.D. STANDARD GALVANIZED PIPE.

4 GATE FRAMES: GATE FRAMES SHALL BE HEAVY DUTY, CONSTRUCTED FROM 1 1/2" I.D. STANDARD GALVANIZED PIPE.

5 FITTINGS: STANDARD FENCE FITTINGS, TENSION BARS, AND POSTS CAPS SHALL BE USED IN THE INSTALLATION.

FABRIC SHALL BE FASTENED TO THE LINE POSTS, TOP, CENTER AND BOTTOM RAILS AT 18" INTERVALS WITH # 9 GUAGE GALVANIZED TIE WIRES.

NOTE: CITY OF RIVERSIDE STANDARD SPECIFICATIONS #461, SECTION 16 SHALL APPLY TO ANY DETAILS NOT COVERED ABOVE.

REVISED 9-21-67 CONCRETE SLAB ADDED

LITTLE LEAGUE BACKSTOP	DATE 8-10-67
BRYANT PARK	SCALE 1" = 10'-0"
	APPROVED
DEPARTMENT OF PARKS & RECREATION RIVERSIDE, CALIFORNIA	SHEET NO. 1 OF 1

10 Aug 67

P-106-5