Connect To Approved Set.

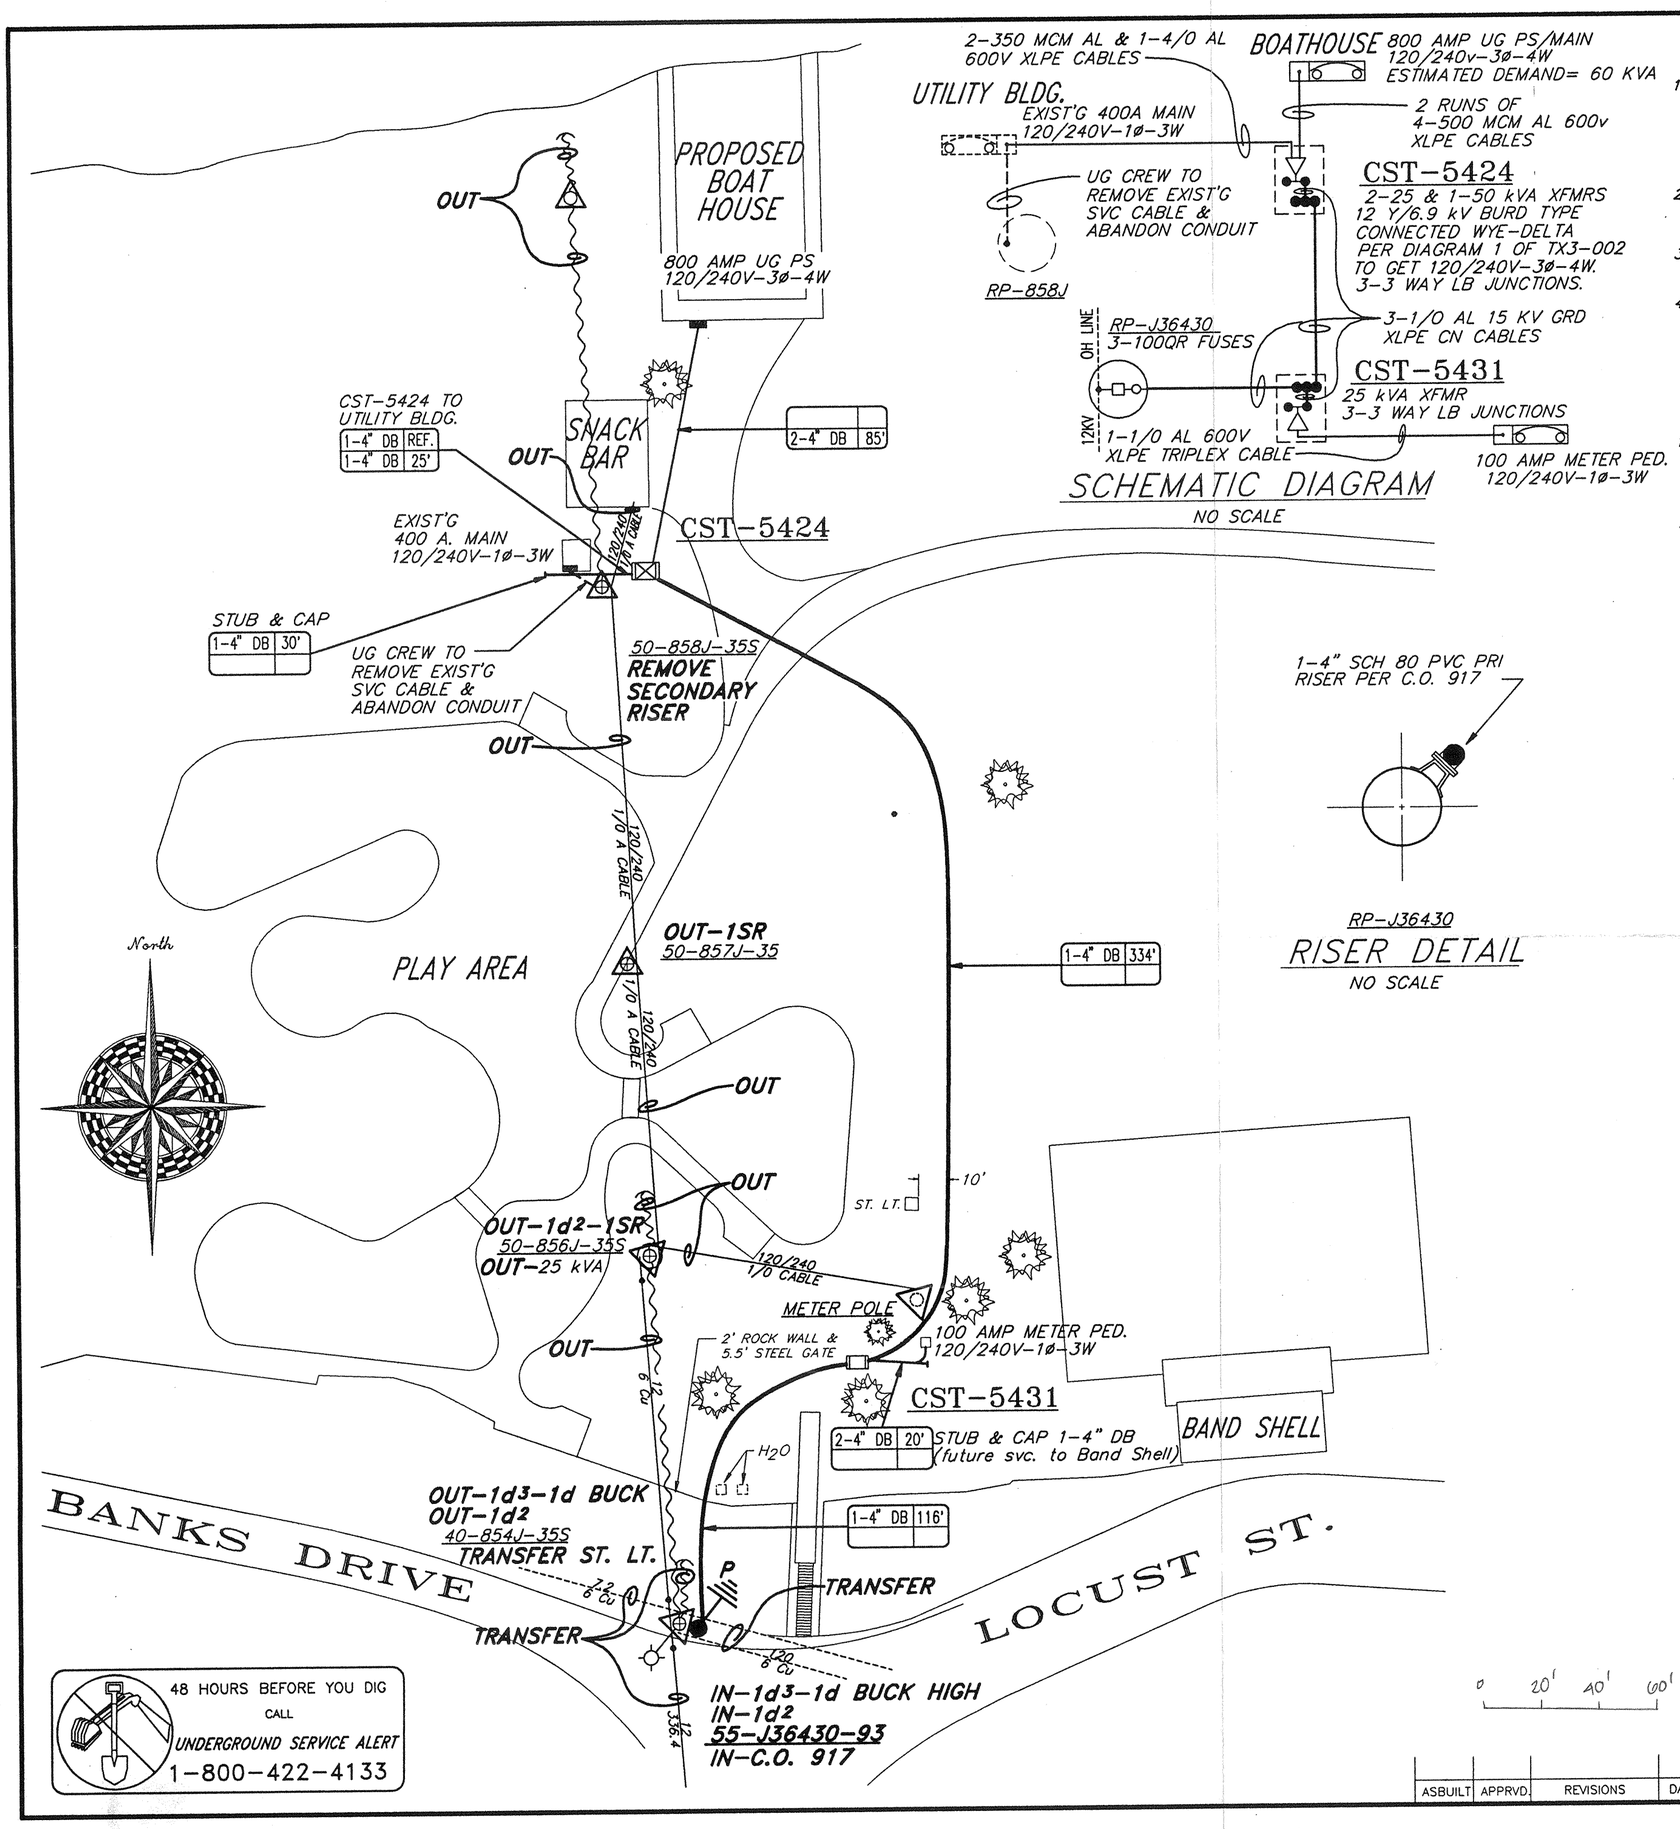

SCHEMATIC DIAGRAM

NO SCALE

CUSTOMER PARTICIPATION

1. ALL FACILITIES INSTALLED BY DEVELOPER SHALL BE INSPECTED AND APPROVED BY THE DEPARTMENT CONSTRUCTION INSPECTOR (PH.782-5429). ANY CHANGES SHALL BE APPROVED BY THE DEPARTMENT PRIOR TO EXECUTION. THE DEVELOPER SHALL BE RESPONSIBLE FOR COORDINATING ALL PHASES OF CONSTRUCTION WITH THE DEPARTMENT CONSTRUCTION SUPT. (PH.351-6100) AFTER THE INSPECTOR HAS NOTIFIED CONSTRUCTION THAT THE CUSTOMER'S WORK IS COMPLETE AND READY FOR DEPT. WORK.
2. PROVIDE AND INSTALL ALL SUBSTRUCTURES, CONDUITS (POLE RISER CONDUIT EXCEPTED), TRENCHING, BACKFILLING, & RESURFACING AS SHOWN IN CONFORMANCE WITH THE FOLLOWING STANDARD DRAWINGS: UGS-100, 100.1, 115.1, & 116.
3. METER ROOM DOOR TO HAVE SCHLAGE LOCK KEYED TO DEPARTMENT MASTER KEY; OR DOUBLE HASP.
4. ALL APPLICABLE SERVICE CHARGES TO BE PAID TO THE DEPARTMENT PRIOR TO INSTALLATION OF DEPARTMENT FACILITIES.

DEPARTMENT PARTICIPATION

1. PROVIDE AND INSTALL ALL POLE RISER CONDUITS, CABLES, TERMINATIONS AND TRANSFORMERS FROM SOURCE TO TERMINATING PULLSECTION OR PULLBOX AS SHOWN IN CONFORMANCE WITH STANDARD CONSTRUCTION METHODS. MATERIALS TO BE SPECIFIED ON JOB MATERIAL LISTS.
2. OBTAIN CIRCUIT NUMBER AND RECLOSER TYPE FROM SUBSTATION OPERATOR.

RISER DETAIL

NO SCALE

UG LEGEND

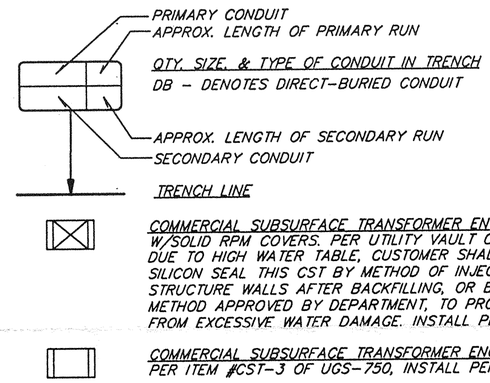

REGISTERED PROFESSIONAL ENGINEER
JOHN L. SEVEY
No. E 12863
Exp.12-31-96
ELECTRICAL
STATE OF CALIFORNIA

8-22-94

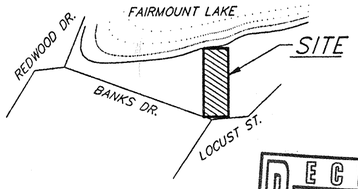

SITE MAP

NO SCALE

RECEIVED
AUG 23 1994
PARK & RECREATION PLANNING & DESIGN

8-22-94

CALL ENGINEERING FOR STAKING

UNDERGROUND/OVERHEAD ELECTRICAL DISTRIBUTION TO

2707 LOCUST ST.

FAIRMOUNT PARK BOAT-HOUSE

SCALE 1"=40'	DRAWN VALDEZ/PHILLIPS	CITY OF RIVERSIDE DEPARTMENT OF PUBLIC UTILITIES	
DATE 8-26-93	CHECKED D. Robinson		
TILE NO. AF16	APPROVED WM 2/9/94	DIV. E	DRAWING NO. U04-4146-2
JPA NO. CR-6862	BOARD DATE 10-15-93		
INV. MAP NO. 9-26, 9-27	ACCT. NO. 510-764200-47060		SHEET 1 OF 1

ASBUILT	APPRVD.	REVISIONS	DATE

0 20' 40' 60'

CUSTOMER