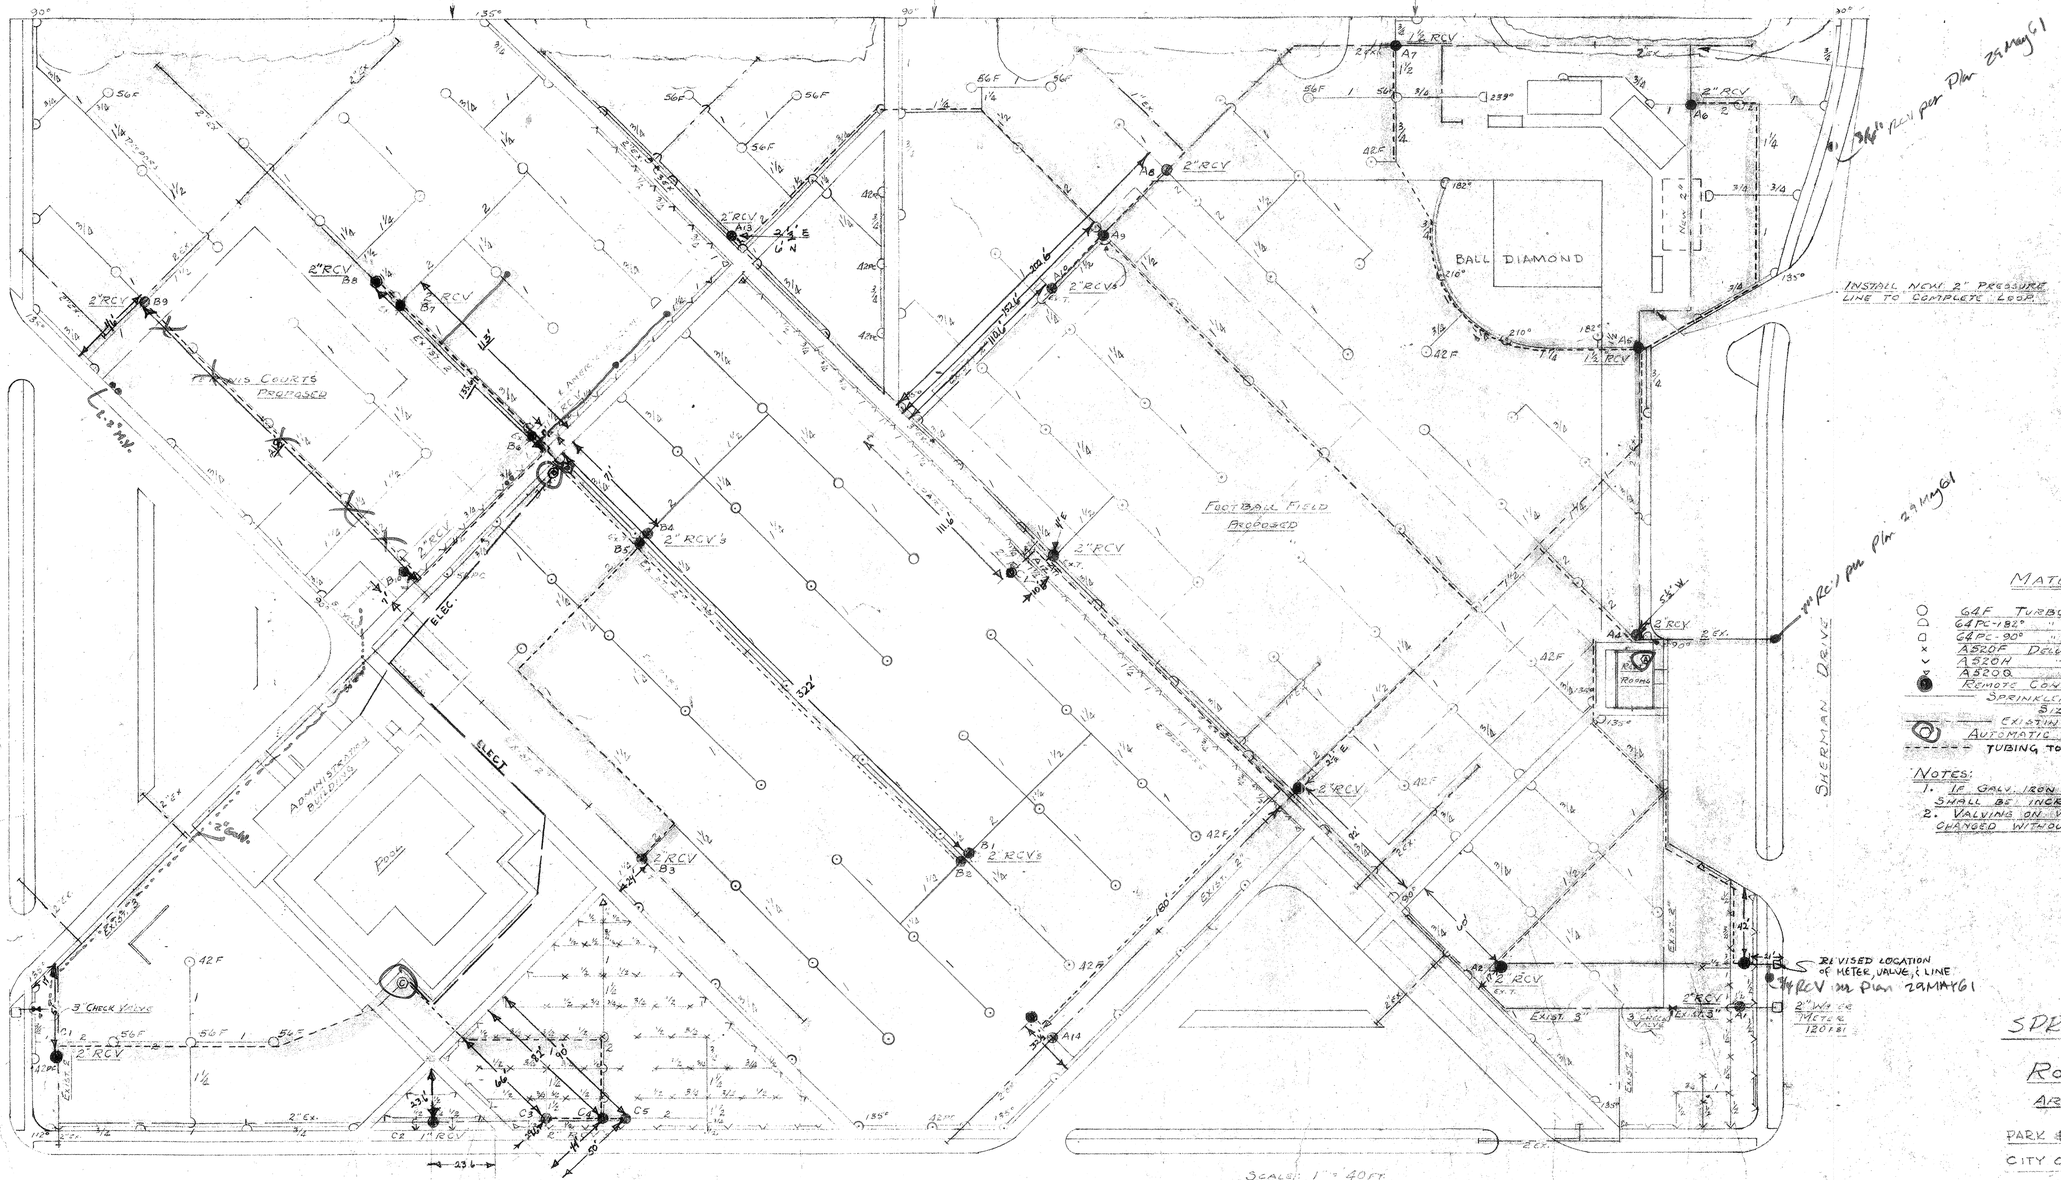

MATERIAL CODE

- 64F TURBO-JET SPRINKLERS - OTHER NOZZLE SIZES AS NOTED
- 64PC-182° " " " " " " " "
- 64PC-90° " " " - OTHER NOZZLES & ANGLES AS NOTED
- A520F DELUXE POP-UP SPRINKLERS
- A520H " " " " " " "
- A520Q " " " " " - OTHER ANGLES AS REQ.
- REMOTE CONTROL VALVES - SIZED AS SHOWN
- SPRINKLER LINES - PVC PLASTIC PIPE - SCHED 40 SIZED AS SHOWN
- EXISTING PRESSURE LINES
- AUTOMATIC SPRINKLER CONTROLLERS
- TUBING TO VALVES FROM CONTROLLERS

NOTES:

1. IF GALV. IRON PIPE IS USED, ALL PIPE SIZING SHALL BE INCREASED TO NEXT LARGER NOMINAL SIZE.
2. VALVING ON VARIOUS CONTROLLERS MAY NOT BE INTERCHANGED WITHOUT ENGINEERING APPROVAL.

SPRINKLER SYSTEM
FOR
ROY C. HUNT PARK
ARLINGTON, CALIF.

PARK & RECREATION DEPARTMENT
CITY OF RIVERSIDE, RIVERSIDE, CALIF.

DESIGNED BY: E. E. Rowland
DATE: 11-12-58

CHECKED BY: E.E.K. APPROVED BY: [illegible]