APPROVALS

DW Bayhman — 12-5-83
PARK AND RECREATION DIRECTOR — DATE

CC Card — 12/5/83
PARK SUPERINTENDENT — DATE

Robert A. Jolley — 12-5-83
PARK PROJECTS COORDINATOR — DATE

Arlene Cruz — 12/5/83
MUSEUM ADMINISTRATIVE CURATOR — DATE

PREPARED IN THE DEPARTMENT OF:
NORTH PARK SECURITY LIGHTING
AN HCD PROJECT

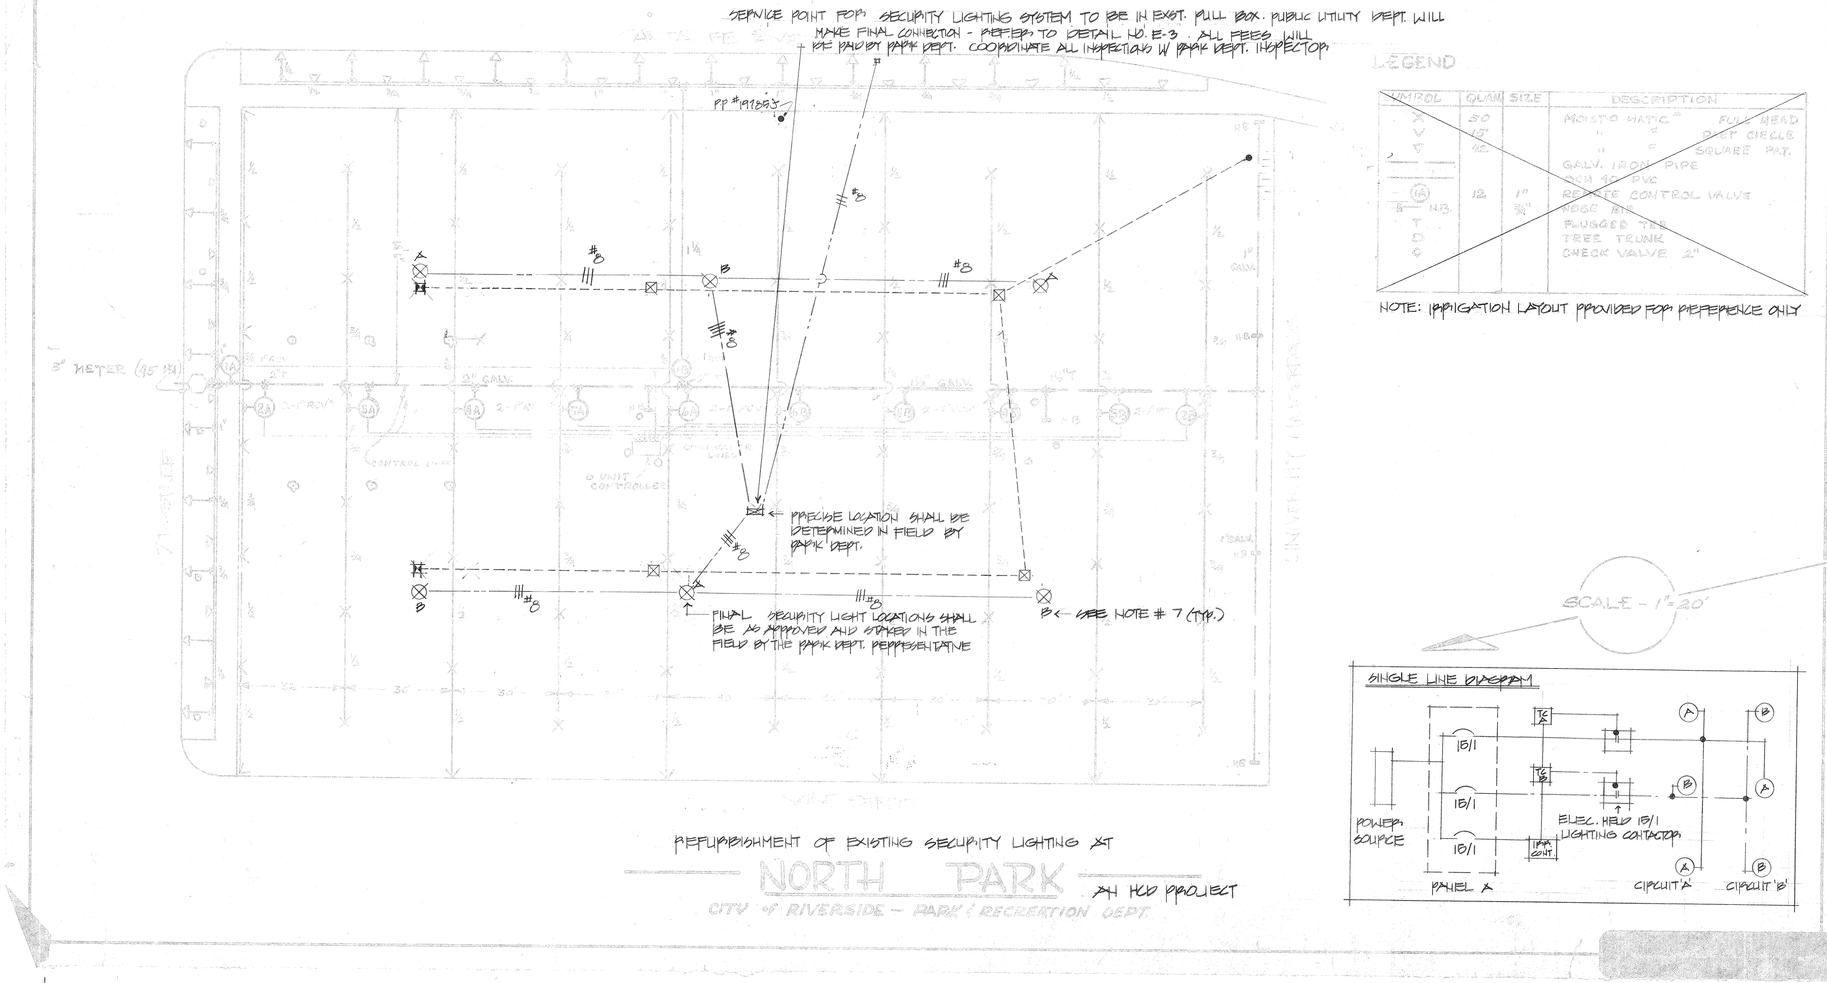

LEGEND

SYMBOL	QUAN	SIZE	DESCRIPTION
	50		MISTO MATIC™ FULL HEAD
	16		" " PART CIRCLE
	42		" " SQUARE PAT.
			GALV. IRON PIPE
			SCH 40 PVC
(VA)	12	1"	REMOTE CONTROL VALVE
NB		3/4"	NIBCO 113
T			PLUGGED TEE
D			TREE TRUNK
Q			CHECK VALVE 2"

NOTE: IRRIGATION LAYOUT PROVIDED FOR REFERENCE ONLY

REFURBISHMENT OF EXISTING SECURITY LIGHTING AT
NORTH PARK
AN HCD PROJECT
CITY OF RIVERSIDE - PARK & RECREATION DEPT.

SINGLE LINE DIAGRAM

LEGEND

- ⊠ EXISTING POLE, FIXTURE & CONCRETE FOUNDATION TO BE SALVAGED DELIVER TO MULBERRY YARD.
- ⋈ LOCATION OF MISSING SECURITY LIGHT
- ---#8--- 1" SCH 40 PVC CONDUIT WITH 2 #8 & 1 #8 GROUND - 36" BELOW F.G.
- ---#8--- 1" SCHEDULE 40 PVC CONDUIT WITH 2 #8 & 1 #8 GROUND WIRES FOR BRANCH CIRCUITS OR 3 #8 FOR FEED CIRCUIT - 36" BELOW F.G.
- ---- EXISTING CONDUIT: REMOVE ALL EXIST'G WIRE, REMOVE ALL CONDUIT LESS THAN 12" BELOW F.G. - ALL CONDUIT BELOW 12" MAY BE ABANDONED IN PLACE.
- ⊠ SECURITY LIGHT TIME CLOCKS - INSTALL IN A LE MEHR ENCLOSURE TYPE B
- ⊗ NEW SECURITY LIGHT LOCATION - FINAL LOCATION AS APPROVED BY PARK & REC DEPT. IN THE FIELD.

NOTES

1. REMOVE & SALVAGE 4 REMAINING SECURITY LIGHT POLES & FIXTURES. DELIVER TO MULBERRY YARD.
2. PULL ALL EXIST'G WIRE FROM EXIST'G SECURITY LIGHT SYSTEM BACK TO BREAKER BOX ON POWER POLE. AND ABANDON EXIST'G CONDUIT.
3. INSTALL NEW SECURITY LIGHTING SYSTEM TO REPLACE EXIST'G USING DECORATIVE CONCRETE POLES AS PROVIDED BY THE PARK DEPARTMENT. LIGHT FIXTURES TO BE MODIFIED TO ADEQUATELY SECURE GLOBES. ALL CONDUIT RUNS TO BE INSTALLED @ 36" BELOW GRADE.
4. ALL CONDUIT TO BE SCHEDULE 40 PVC EXCEPT WHERE RIGID OTHERWISE BY CODE AND/OR PUBLIC UTILITY DEPARTMENT STANDARDS.
5. CONTRACTOR TO PROVIDE "AS BUILT" INFORMATION.
6. PROTECT IN PLACE ALL ITEMS NOT DESIGNATED ON THE PLAN FOR REMOVAL. ALL DAMAGE TO EXISTING IMPROVEMENTS SHALL BE REPAIRED BY THE CONTRACTOR AT NO COST TO THE CITY.
7. SYSTEMS 'A' & 'B' OF SECURITY LIGHTING SYSTEM SHALL BE INSTALLED TO OPERATE ON INDEPENDANT TIME CLOCKS. PROGRAM AS DIRECTED BY PARK DEPT.

city of riverside
park & recreation department
3900 MAIN ST RIVERSIDE, CALIFORNIA 92522
(714) 787-7223

revisions	by

date	NOV. 1983
design	KDH
drawn	KDH
check	
acc't.no.	13-881-486
SHEET	1 of 1
JOB NO.	0201

90-ON