NOTE: CONTRACTOR SHALL PROVIDE AND INSTALL FLOOD LIGHTS, CONDUCTORS, AND CONTROL EQUIPMENT WITHIN THE EXISTING PANEL PER PROJECT SPECIFICATIONS AND AS LOCATED PER PLAN. CONTRACTOR WILL SIZE THE WIRES PER CODE AND PROVIDE CONDUITS BACK TO THE EX. PULL BOX. REFERENCE DRAWINGS WILL BE AVAILABLE FOR CONTRACTOR. EX. PANEL IS ABOUT 700 FEET AWAY.

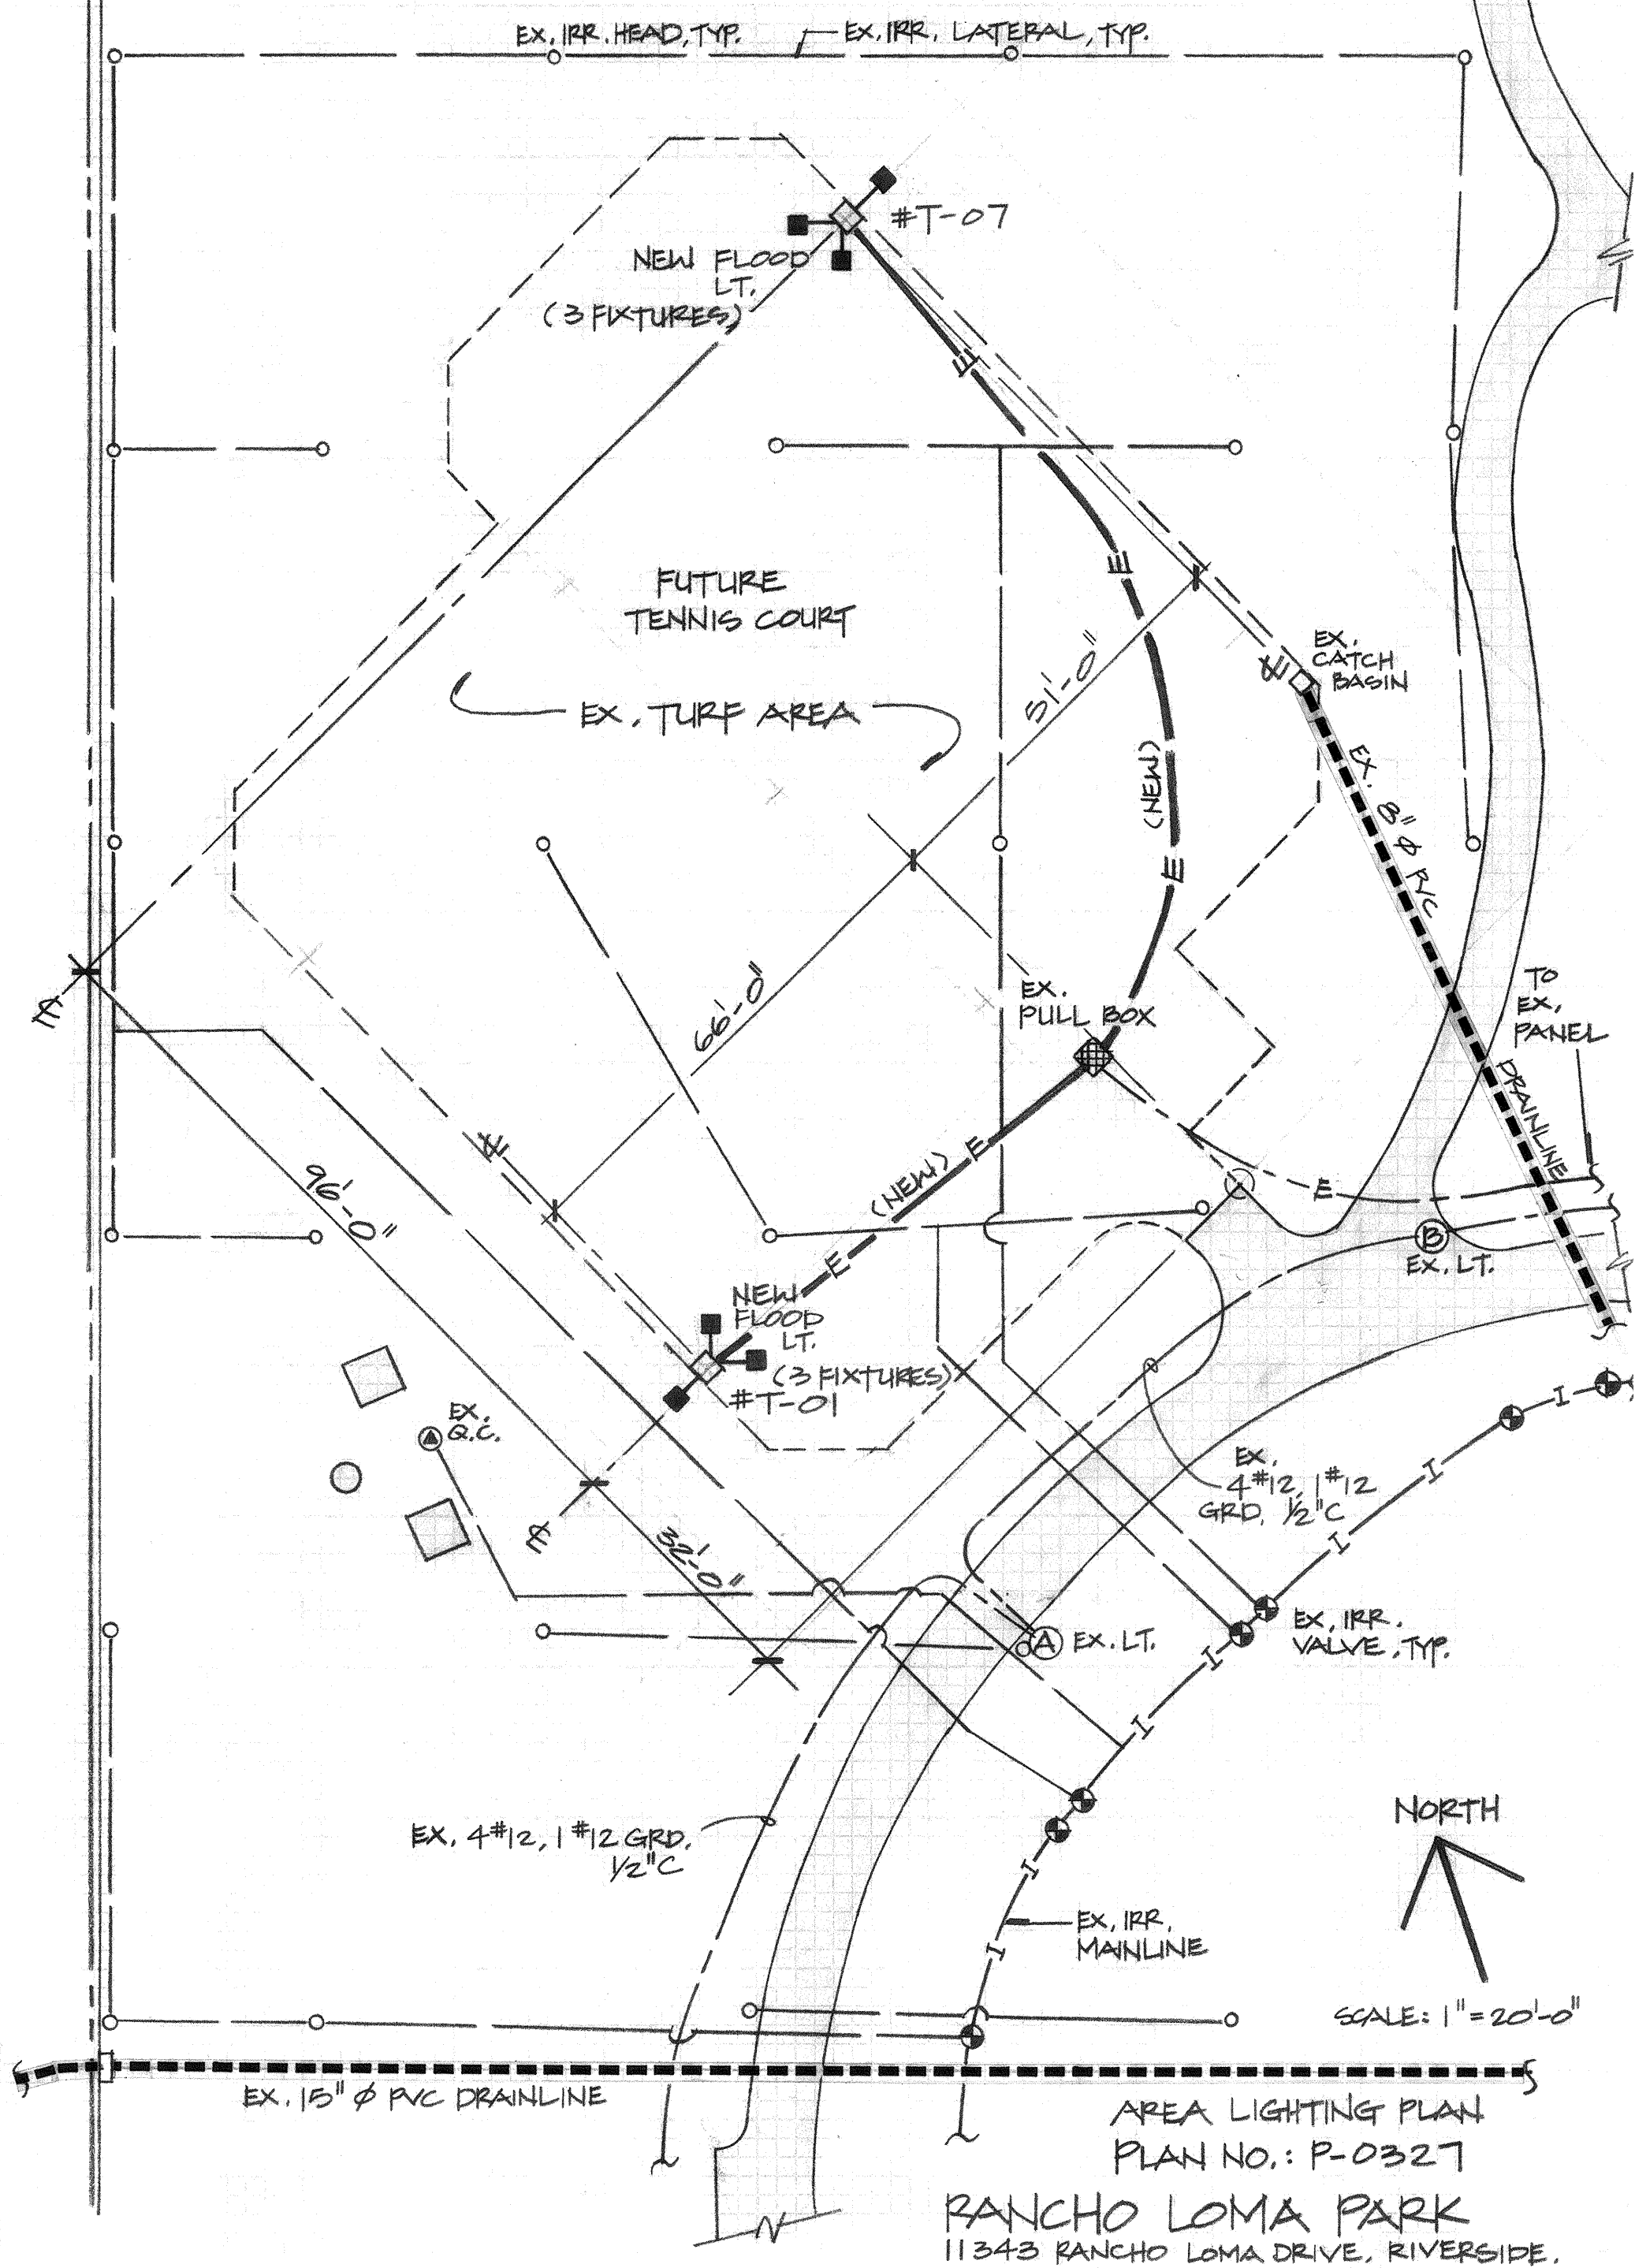

AREA LIGHTING PLAN
PLAN NO.: P-0327

RANCHO LOMA PARK
11343 RANCHO LOMA DRIVE, RIVERSIDE.