


- NOTES:**
1. REFERENCE SPECIFICATIONS FOR ADDITIONAL INFORMATION ON PULLBOX.
  2. REFERENCE ELECTRICAL SITE PLAN FOR SIZE OF CONDUITS.
  3. DIMENSIONS SHOWN FOR PULLBOX ARE TO BE AS SHOWN ON ELECTRICAL SYMBOLS UNLESS NOTED OTHERWISE ON ELECTRICAL SITE PLAN KEYNOTES.
  4. PROVIDE SCHEDULE 80 SWEEPS INTO PULLBOX WHERE SWEEPS ARE REQUIRED.

**PULLBOX INSTALLATION DETAIL**  
NO SCALE


1  
E3

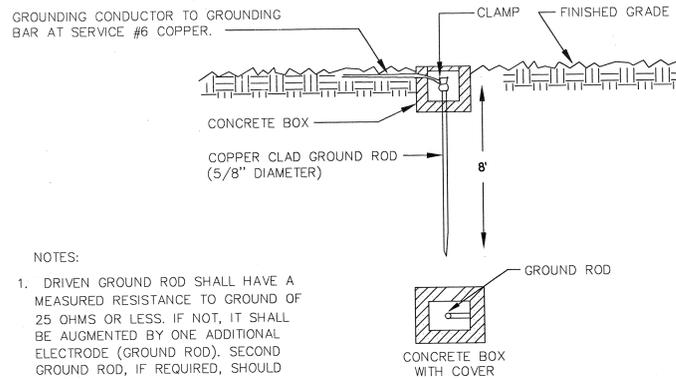

- NOTES:**
1. DRIVEN GROUND ROD SHALL HAVE A MEASURED RESISTANCE TO GROUND OF 25 OHMS OR LESS. IF NOT, IT SHALL BE AUGMENTED BY ONE ADDITIONAL ELECTRODE (GROUND ROD). SECOND GROUND ROD, IF REQUIRED, SHOULD BE A MINIMUM OF 6' FROM FIRST.

**DRIVEN GROUND ROD DETAIL**  
NO SCALE


3  
E3

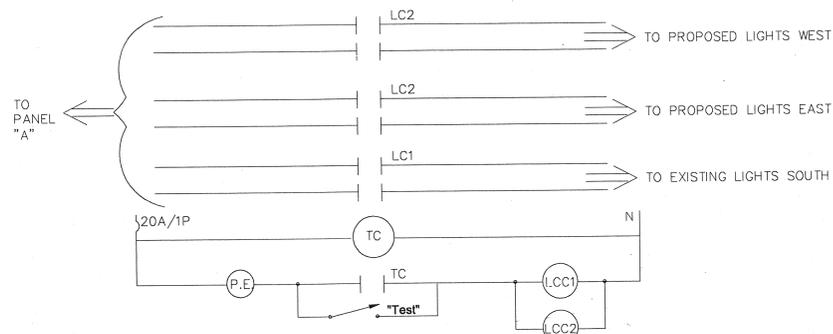

- NOTES:**
1. ALL CONTROL EQUIPMENT SHOWN ABOVE IS EXISTING AND TO BE REUSED UNLESS OTHERWISE INDICATED. E.C. IS TO PROVIDE LIGHTING CONTACTOR COIL LCC2 AND LIGHTING CONTACTORS LCC2.
  2. ALL CONTROL WIRING TO BE #12THWN COPPER IN 1/2" C WHERE EXPOSED.
  3. RATINGS OF CONTACTS TO MATCH CIRCUIT BREAKER.
  4. MOUNT NEW CONTACTORS AND COIL IN EXISTING METER PEDESTAL, REF. DETAIL.
  5. ALL LIGHTS (OLD AND NEW) WILL BE CONTROLLED BY P.E. CELL ON AND TIMECLOCK OFF. PROVIDE NEW H-O-A OPERATION (ON-OFF-MANUAL).

**CONTROL DIAGRAM - EXTERIOR LIGHTING**  
NO SCALE

2  
E3

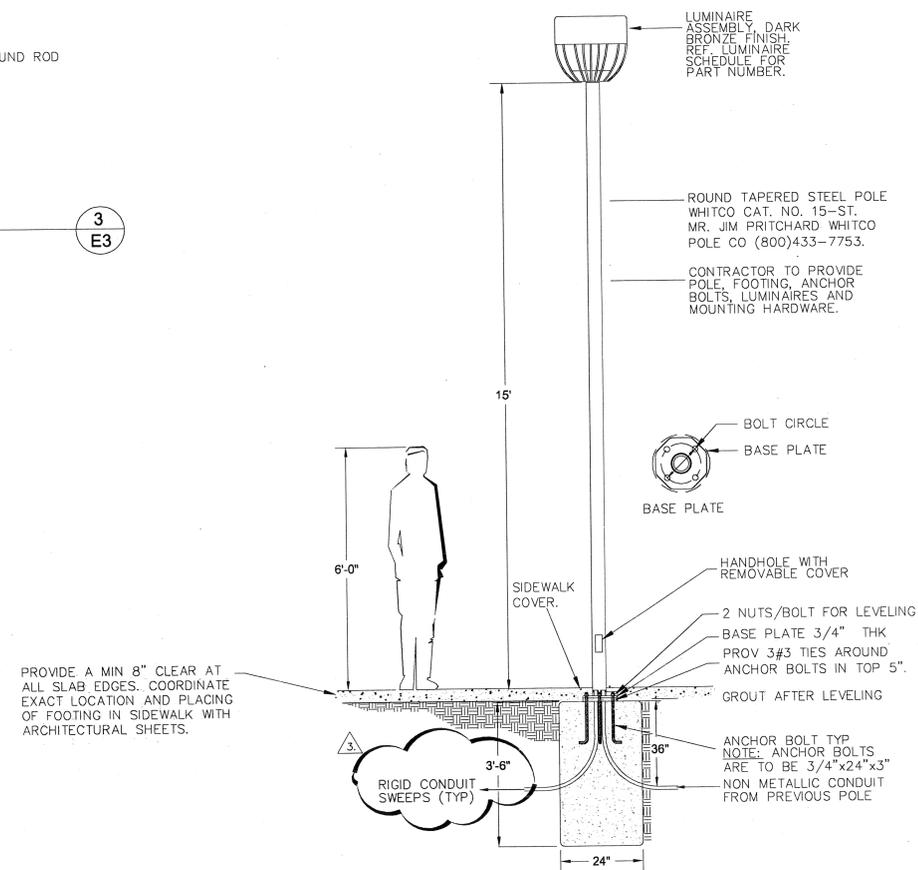

**DETAIL - FIXTURE "A2" WALKWAY POLE**  
NO SCALE

4  
E3

**THUNDERSKY PARK  
8.7 ACRE ADDITION  
ELECTRICAL  
DETAIL SHEET**

**ORANGECREST COUNTRY**  
Communities Southwest  
181 old springs road  
anaheim, california 92808  
1 714 279.6555 fax 1714 279.6556  
contact: Mary Rauschenburg

1. ADDED EAST WALKWAY LIGHTS 2/09/00	R.M.
2. PER CITY COMMENTS 2/23/00	R.M.
3. PER CITY COMMENTS NO OBS. 3/16/00	R.M.
4. CLIENTS COMMENTS 5/16/00	D.Z.
5. ADDED 3#3 TIES 9/15/00	R.M.

date: 12/1/99  
drawn: JMN  
checked:  
project no: 9912041  
file name: tskypke?  
sheet

