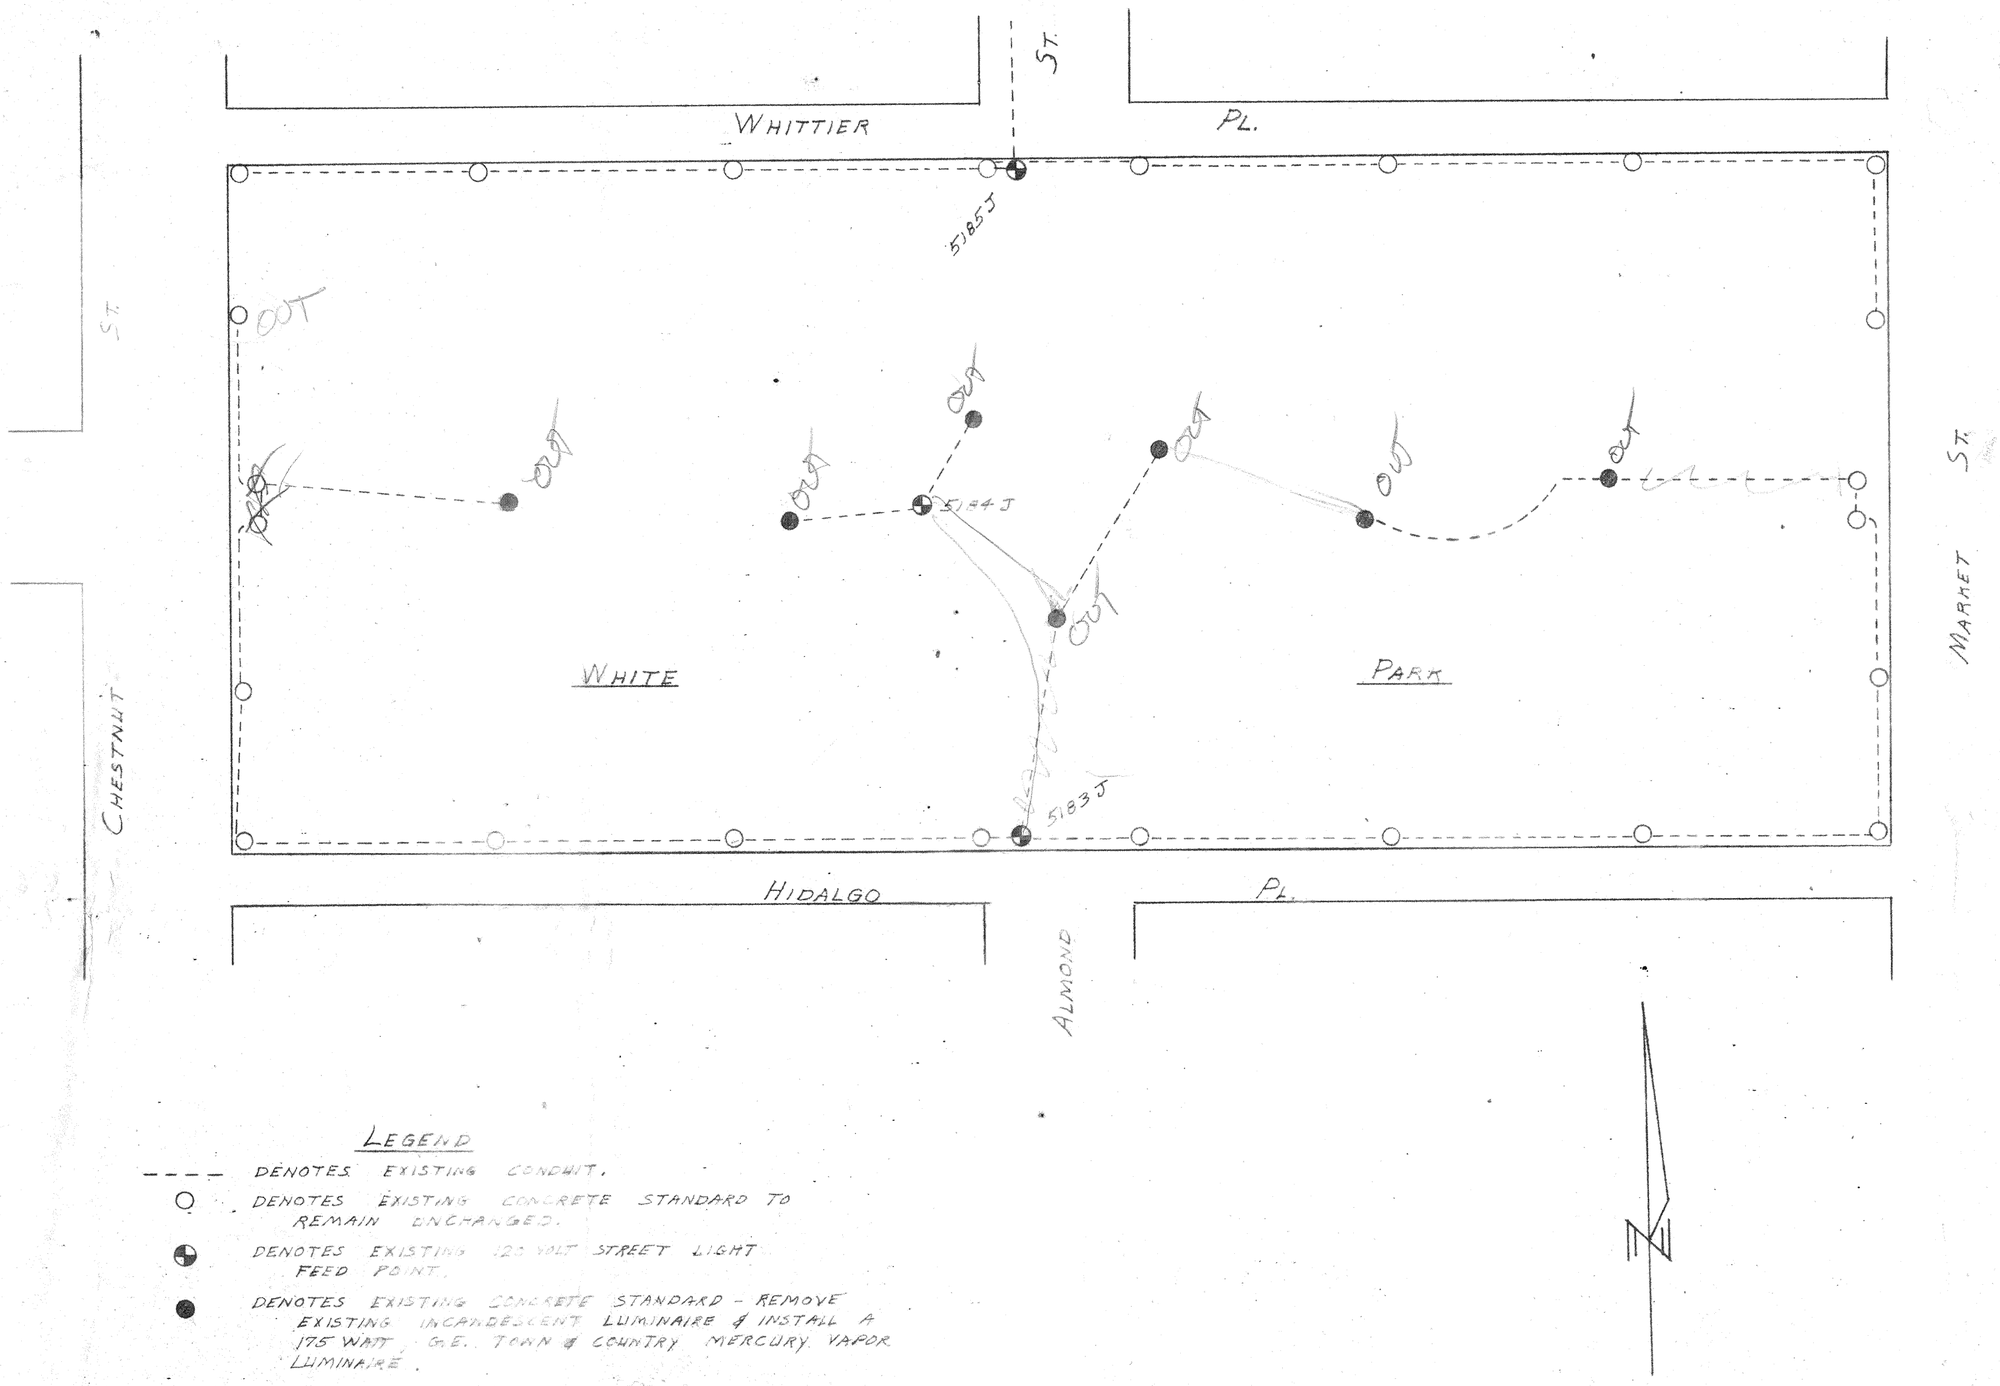

LEGEND

- - - - DENOTES EXISTING CONDUIT.

○ DENOTES EXISTING CONCRETE STANDARD TO REMAIN UNCHANGED.

◐ DENOTES EXISTING 120 VOLT STREET LIGHT FEED POINT.

● DENOTES EXISTING CONCRETE STANDARD - REMOVE EXISTING INCANDESCENT LUMINAIRE & INSTALL A 175 WATT G.E. TOWN & COUNTRY MERCURY VAPOR LUMINAIRE.

WHITE PARK INTERNAL LIGHTING UPGRADE - INCANDESCENT TO MERCURY VAPOR

SCALE 1"=50'	DRAWN WEH	CITY OF RIVERSIDE DEPARTMENT OF PUBLIC UTILITIES
DATE 8-29-69	CHECKED WEH	
JOB No	APPROVED	ELEC. DIV. — DRAWING NO. L4-4704
F. B. No		

APPRVD	REVISIONS	DATE