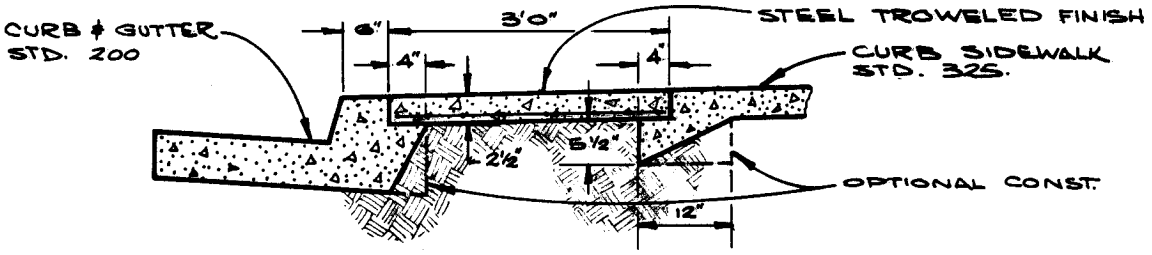

SECTION A-A
NEW CURB GUTTER AND SIDEWALK

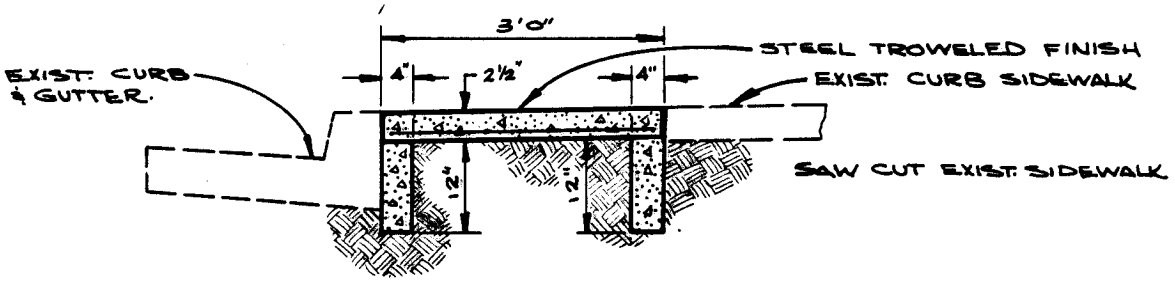

SECTION A-A
EXIST. CURB GUTTER AND SIDEWALK
SCALE 1" = 2'

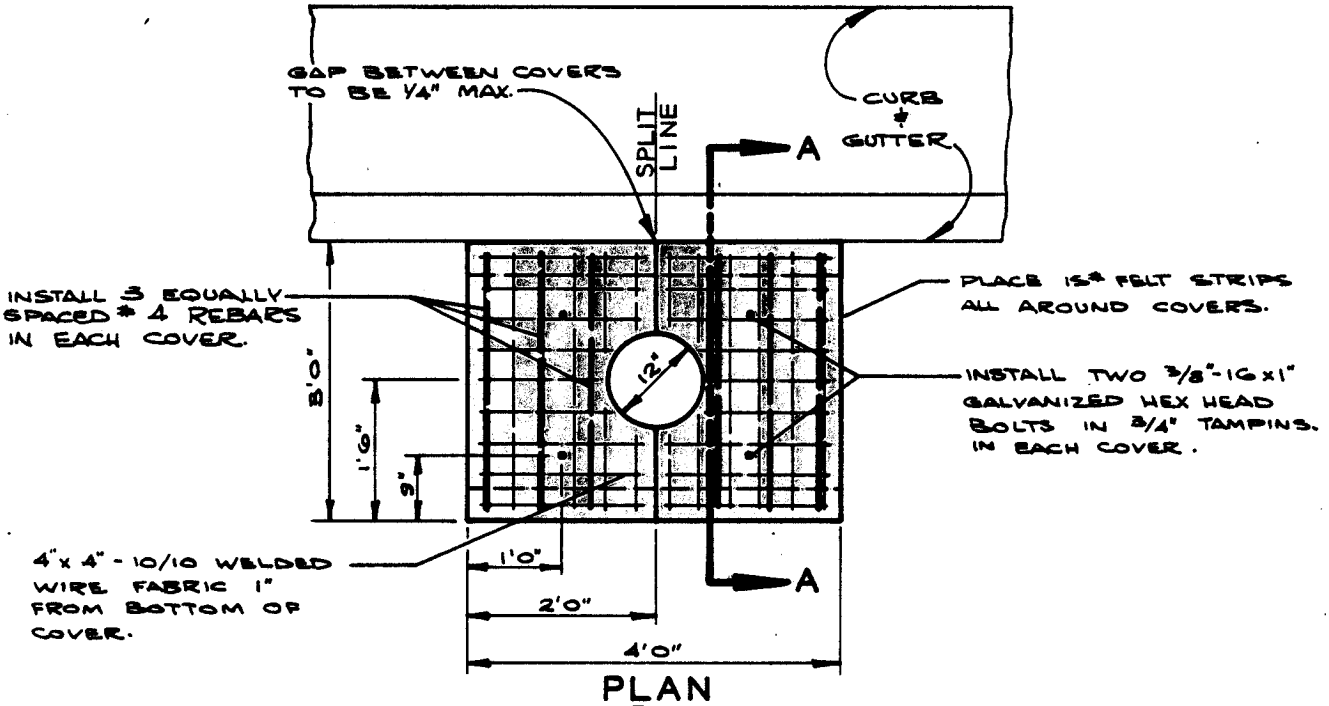

PLAN
SCALE 1" = 2'

1. CONCRETE IN COVERS SHALL BE CLASS 560-D-3250.
2. COVERS SHALL BE 2½" THICK.
3. COVERS SHALL BE CAST IN PLACE.

APPROVED Robert P. Wales DATE 8/3/78
PUBLIC WORKS DIRECTOR - R.C.E. 18793

MARK	REVISIONS	APPR.	DATE

CITY OF RIVERSIDE
PUBLIC WORKS DEPT. - ENGINEERING DIV.

TREE WELL AND COVERS

STANDARD DRAWING NO. **326**