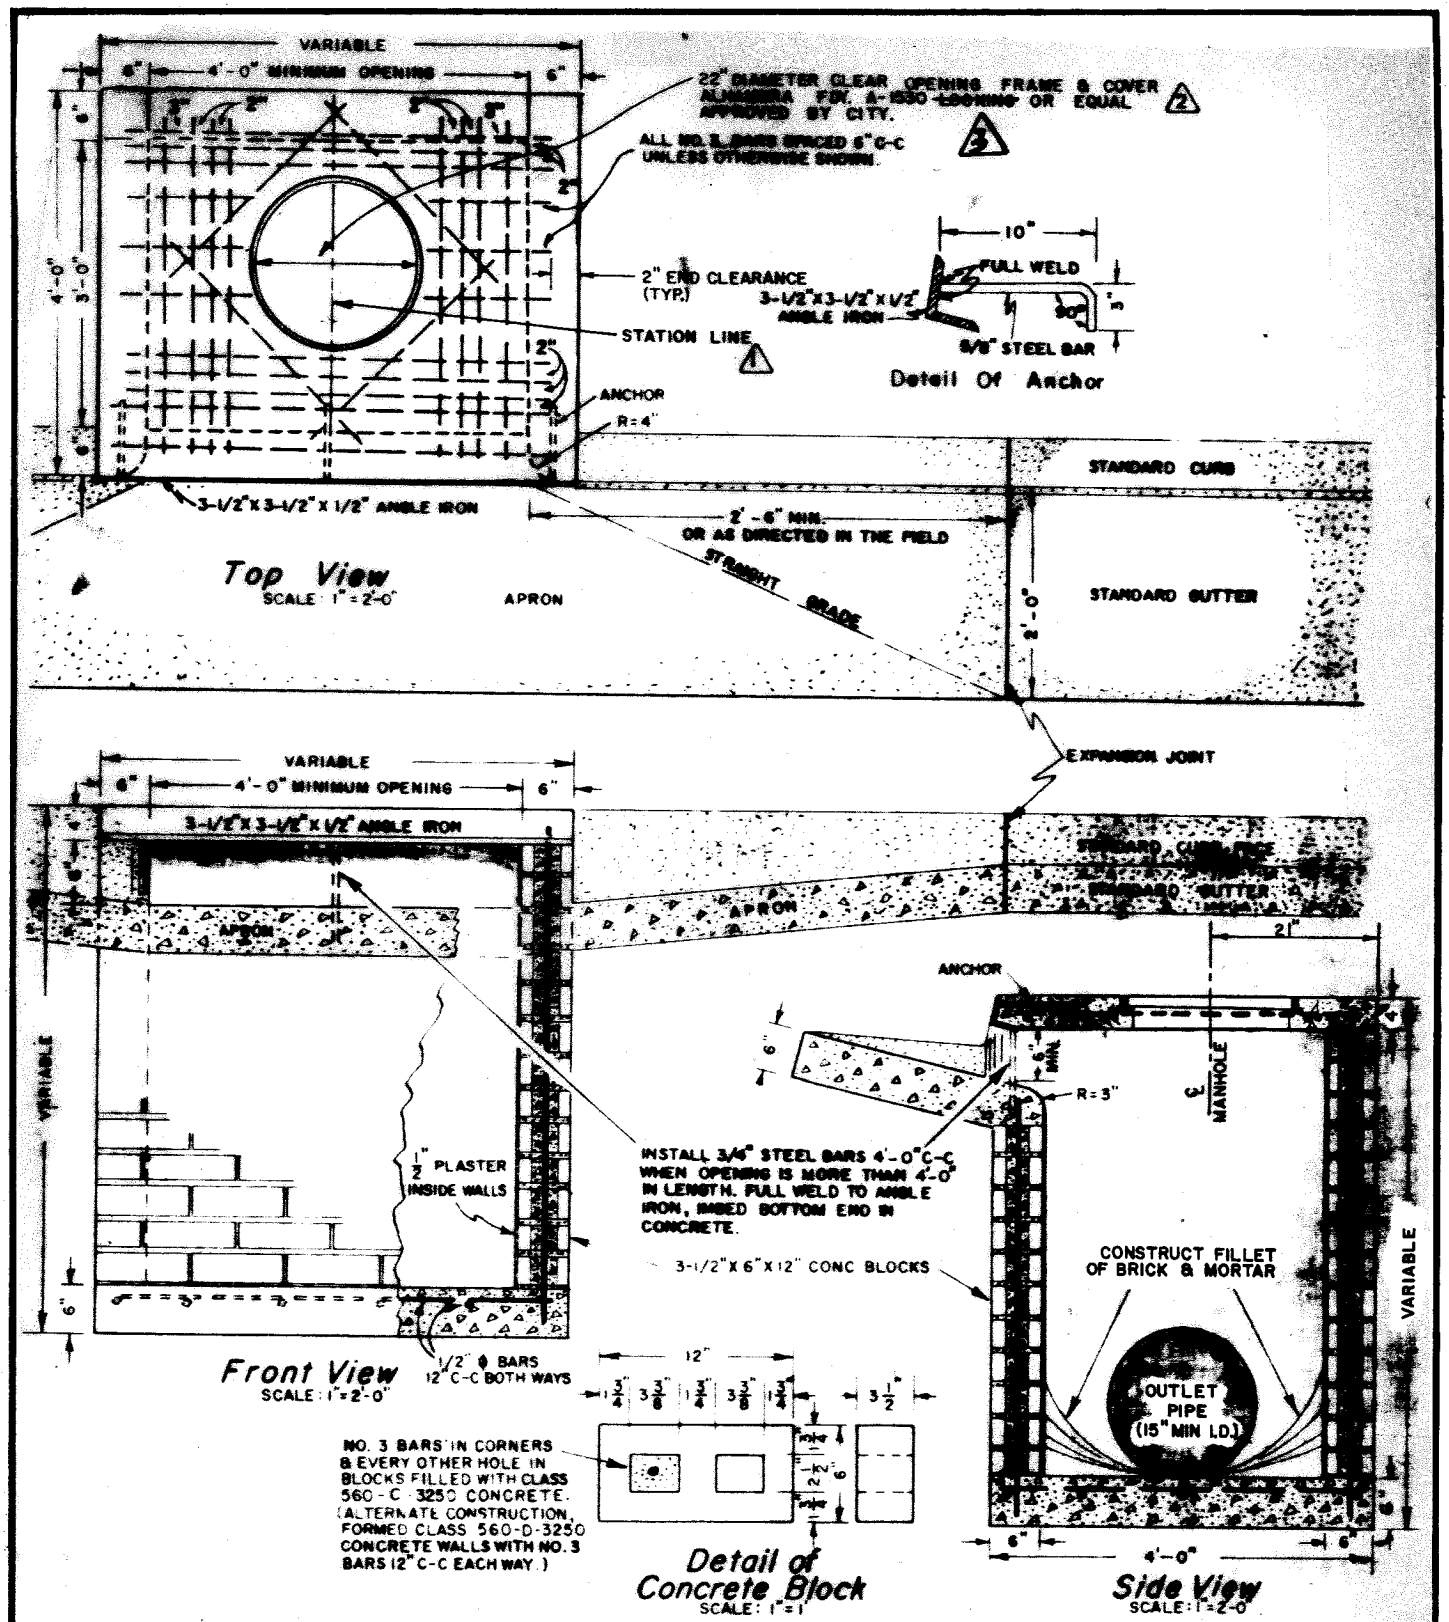

NOTE: PIPE SIZE AND OUTLET TO BE SHOWN ON GENERAL PLANS. STANDARD CATCH BASIN TO BE 4'-0" X 3'-0" INSIDE UNLESS OTHERWISE SHOWN ON GENERAL PLANS. CONSTRUCT 1/2" PER FOOT SLOPE ON BOTTOM OF CATCH BASIN TOWARD OUTLET. THE AMOUNT AND LENGTH OF STEEL USED IN CONSTRUCTION TO VARY ACCORDING TO THE SIZE OF THE CATCH BASIN.

APPROVED Robert P. Wales DATE 8/3/78
PUBLIC WORKS DIRECTOR - R.C.E. 18793

MARK	REVISIONS	APPR.	DATE
1	Added Station Line	wdg	8-25-80
2	Changed Sq. Manhole to Round	wdg	7-7-82
3	REMOVED LOCKING REQ'M	[illegible]	4/29/04

CITY OF RIVERSIDE

PUBLIC WORKS DEPT. - ENGINEERING DIV.

STORM WATER CATCH BASIN TYPE 1

STANDARD DRAWING NO. 400