



PLAN VIEW

| W   | D      |
|-----|--------|
| 6'  | 1"     |
| 8'  | 1 1/2" |
| 10' | 1 1/2" |

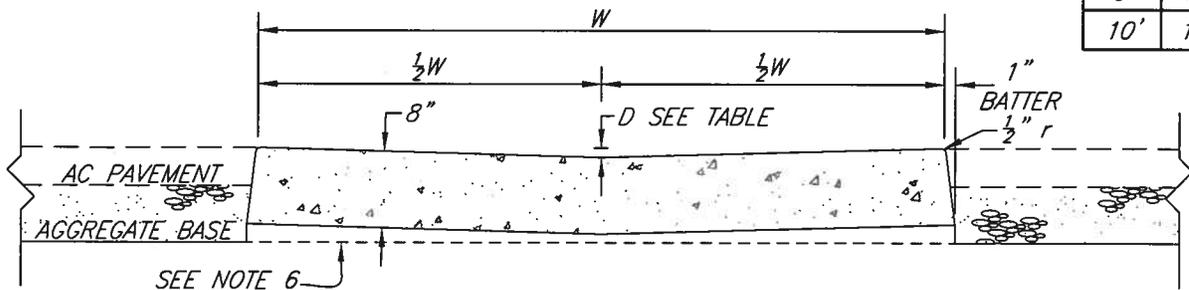


SECTION A - A

SHAPE CURB PER  
STD. 200 WITH  
VAR. CF

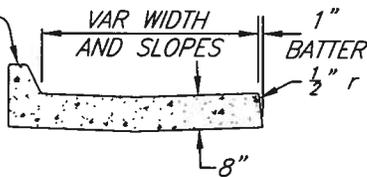


SECTION B - B

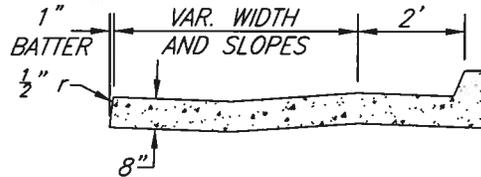

SECTION C - C

**NOTES:**

1. Concrete shall be class 560-C-3250.
2. W shall be 6' unless otherwise specified.
3. Reduce CF to insure drainage away from FL on upstream curb return.
4. Install 1/2" expansion joints at curb returns.
5. Construct weakened plane joints at locations indicated by (WP).
6. When structural section exceeds 14", the base shall be continued under cross gutter.
7. For commercial driveway approach see STD 302.

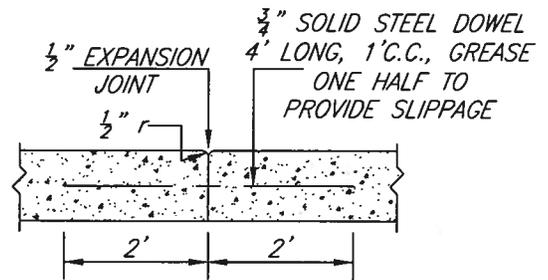

EXPANSION JOINT  
DETAIL

APPROVED BY

*[Signature]*  
CITY ENGINEER

5/18/11  
DATE

CITY OF RIVERSIDE  
PUBLIC WORKS DEPARTMENT

CROSS GUTTERS

STANDARD DRAWING NO. 220

Sheet 1 of 1

MARK REVISIONS APPR. DATE