


4 TEMPORARY 8" STL PIPE, CTF


NOTE: SEE CWD-621-2 FOR MATERIAL LIST

POUR THRUST BLOCK PER CWD-030 AGAINST VAULT WALL

13 VAULT AND COVER PER CWD-801-1 & 801-2

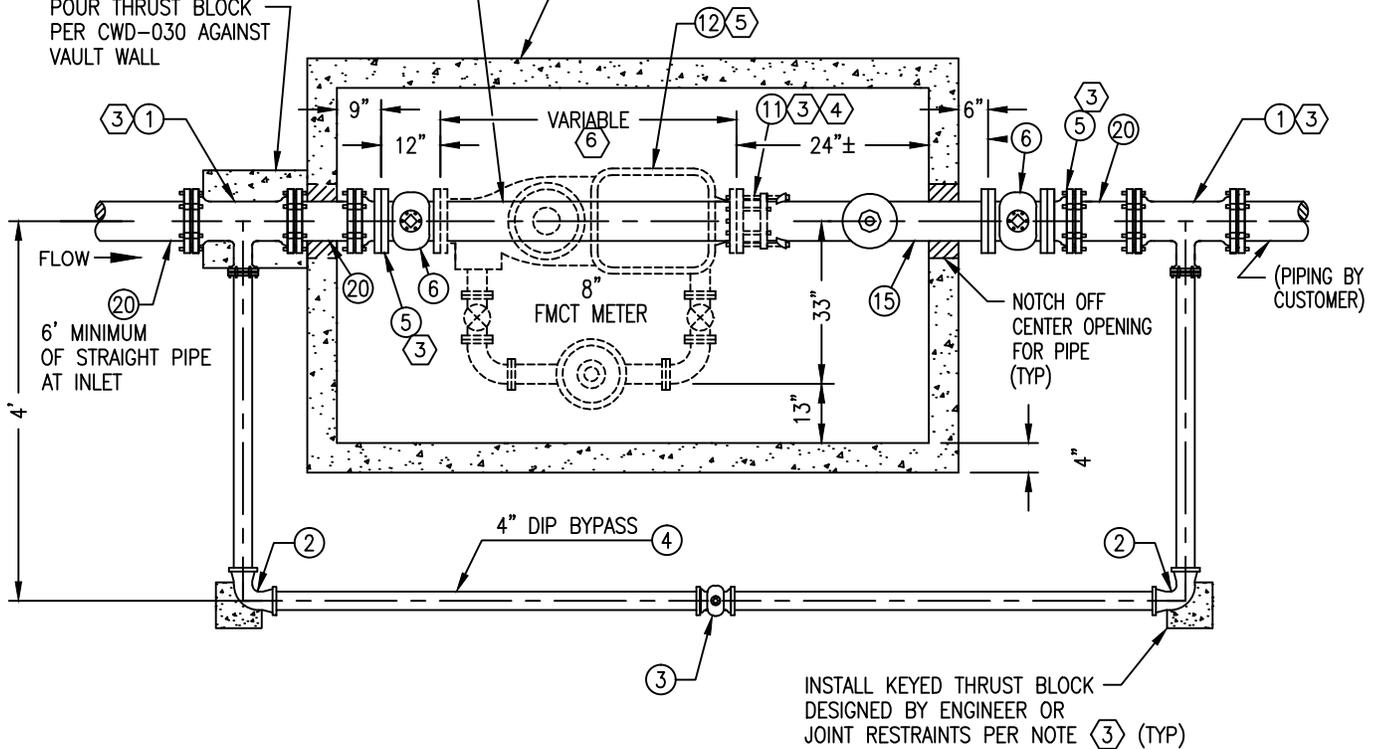

PLAN VIEW

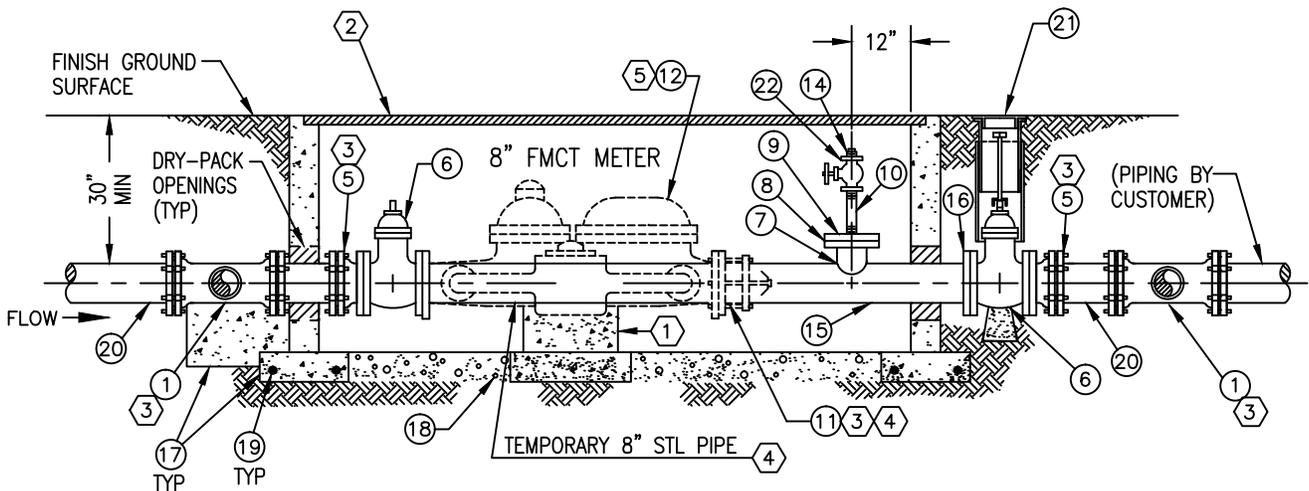

PROFILE VIEW

GENERAL NOTES:

- 1 SUPPORT METER ON CONCRETE PAD AND CONCRETE BLOCK.
- 2 ADJUST VAULT AND COVER TO MEET SIDEWALK AND CURB GRADE. PAINT PER CONSTRUCTION SPECIFICATION SECTION 310.
- 3 RESTRAIN ALL MECHANICAL JOINTS PER CONSTRUCTION SPECIFICATIONS.
- 4 CONTRACTOR SHALL INSTALL ALL PIPE, FITTINGS, AND MATERIALS BETWEEN THE TAPPING GATE AND "PIPING BY CUSTOMER", INCLUDING TEMPORARY FLANGE COUPLING CONNECTION AT THE INFLUENT VALVE. LOCATION.
- 5 CITY FORCES WILL FURNISH AND INSTALL 8" FMCT METER AND FAB METER READING LID.
- 6 VARIABLE LENGTH IS PER MANUFACTURER'S REQUIREMENTS.



WATER DISTRIBUTION & TRANSMISSION
PIPELINE CONSTRUCTION METHODS

8" FMCT WATER SERVICE