


Revision _____
 DATE: 8/20/07
 Update Format _____
 REVISION: _____
 DATE: 9/10/07
 APPROVAL: *Dave Redding*



STANDPIPE VENTS- 18-INCH STEEL

UGS

STANDPIPE VENT - 18 INCH STEEL

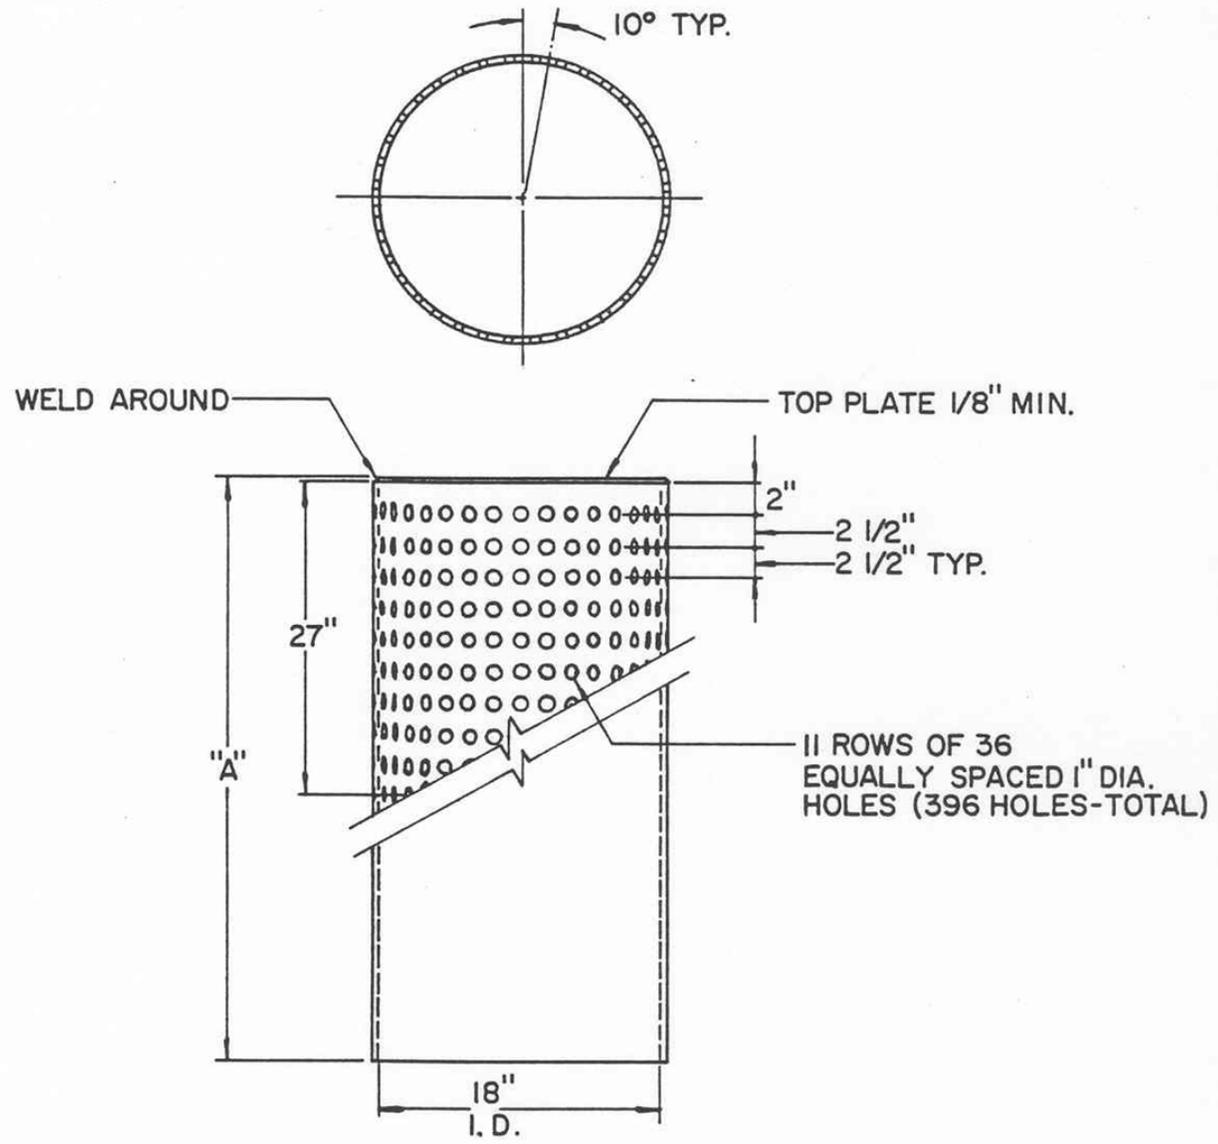

NOTES:

1. Dimension "A" to be 40" (min.) unless otherwise specified on working drawing.
2. Material shall be steel or iron-pipe or casing -1/8"min. thickness.
3. Finish to be hot dip galvanized unless otherwise specified on working drawing.
4. Install per UGS-233 EXCEPT use 18-inch air duct, 30-inch square concrete around vent from grade to horizontal duct, and 21-inches to centerline from face of curbs.