



CAPPING MAIN LINE CONDUIT

RIVERSIDE PUBLIC UTILITIES DEPT. — UNDERGROUND STRUCTURES

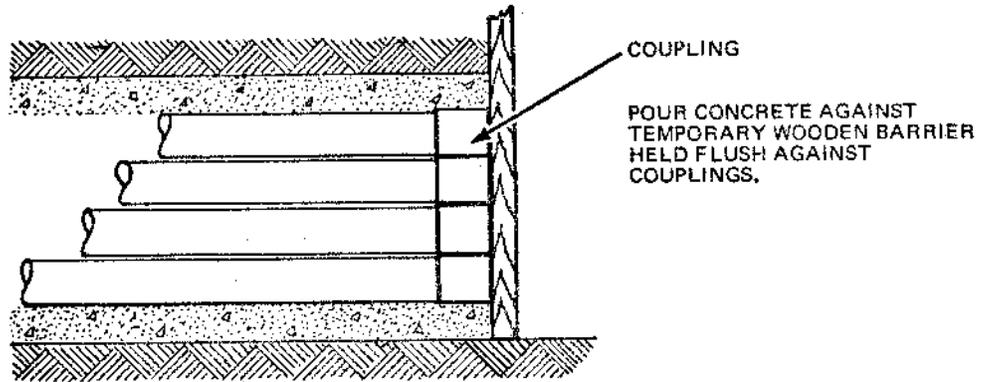

TYPICAL DUCT BANK

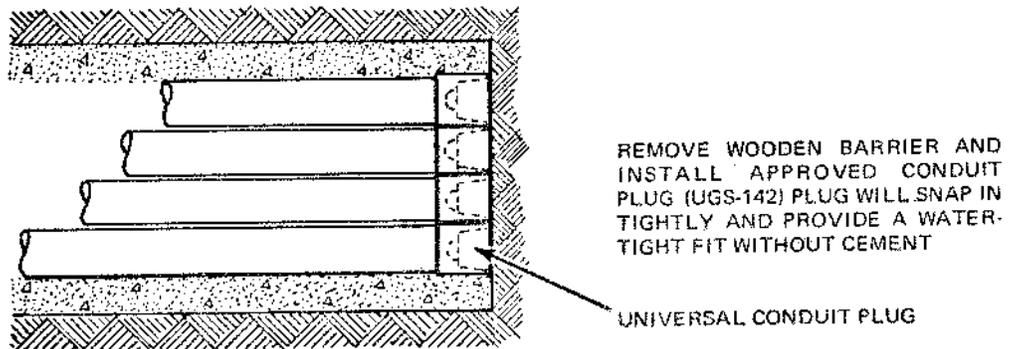

COMPLETED CAPPED DUCT ASSEMBLY

NOTES:

1. WHEN CAPPING UNENCASED CONDUIT (2 MAX.); INSTALL CONDUIT PLUG IN COUPLING SAME AS SHOWN ABOVE. (DO NOT STAGGER).
2. SEE UGS-125 FOR CONDUIT SPACING AND CONCRETE ENCASEMENT.