

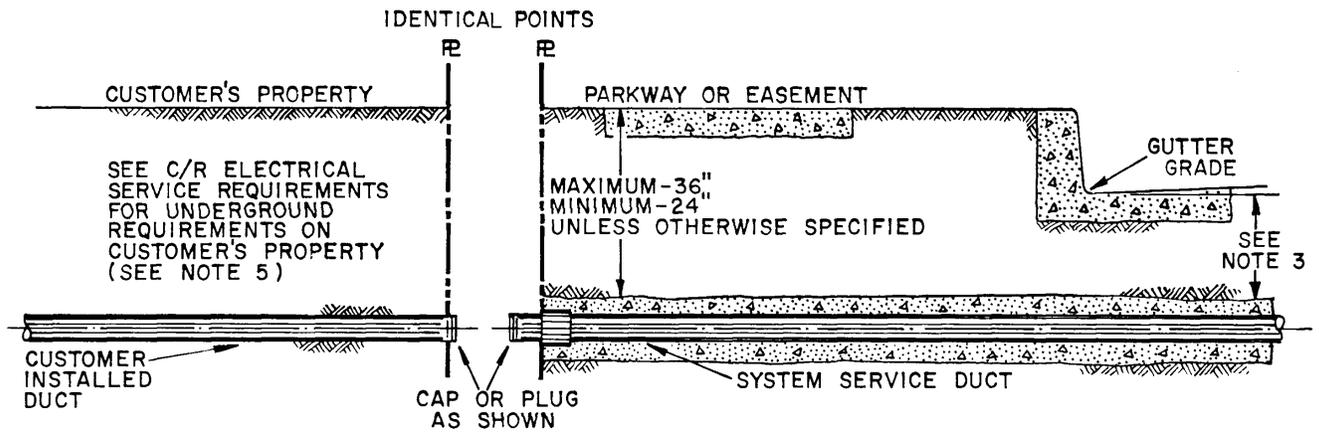


SERVICE LATERAL TERMINATIONS


RIVERSIDE PUBLIC UTILITIES DEPT.-UNDERGROUND STRUCTURES

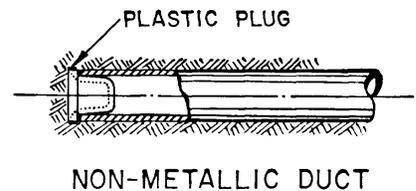

TYPICAL DUCT TERMINATIONS

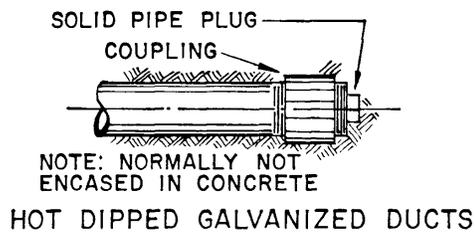

TERMINATIONS FOR DIRECT BURIAL

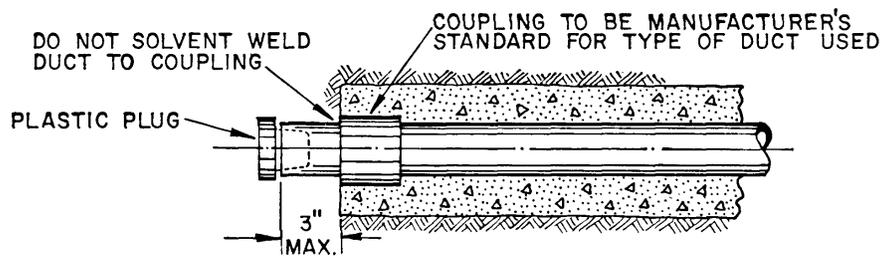

ENCASED DUCT TERMINATION

NOTES:

1. ALL SERVICE LATERALS SHALL TERMINATE IN SUCH LOCATION THAT AN EXTENSION OF SAME SHALL HAVE 12" MINIMUM CLEARANCE FROM PROPERTY LINE CORNER.
2. SEE UGS-100 FOR APPROVED TYPE OF DUCT.
3. SEE UGS-100.1 FOR GENERAL TRENCH, BACKFILL AND CONCRETE REQUIREMENTS.
4. SEE UGS-125 FOR DUCT SPACING REQUIREMENTS.
5. WHERE A DUCT IS STUBBED OUT TO CURB OR PROPERTY LINE TO BE PICKED UP LATER BY THE DEPARTMENT, IT MUST TERMINATE ON A LEVEL COURSE AT A MAXIMUM DEPTH OF 36" AND A MINIMUM DEPTH OF 24".