



TOP VIEW

STRUCTURE	GROUND WIRE
PJC	1/0
BTE	1/0
TP	1/0
PULL BOX	4/0
SLAB BOX	4/0
CST	4/0
MANHOLE	4/0
VAULT	4/0

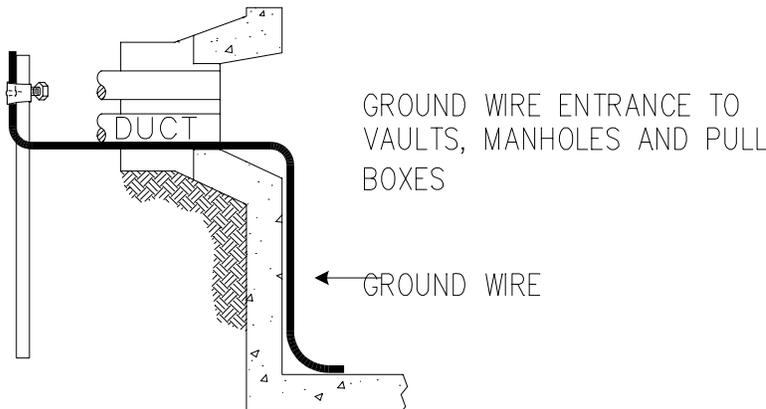

SECTION "BB"

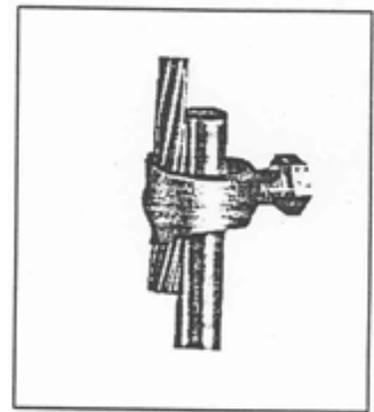

MECHANICAL CONNECTOR DETAIL

NOTES:

1. At the discretion of the inspector, 60' of 4/0 soft drawn bare copper wire may be installed in the trench bottom in lieu of ground rods if rocky soil interferes with ground rod installation.
2. Leave enough ground wire to wrap the interior perimeter of the structure.
3. Refer to individual standards for ground wire terminator.
4. Mechanical ground connector shall be per Anderson Cat. No.GC-103-02 or Department approved equal.