



**COLD JOINTS**  
(APPROVED FOR USE AT CONTRACTORS REQUEST)

RIVERSIDE PUBLIC UTILITIES DEPT.—UNDERGROUND STRUCTURES

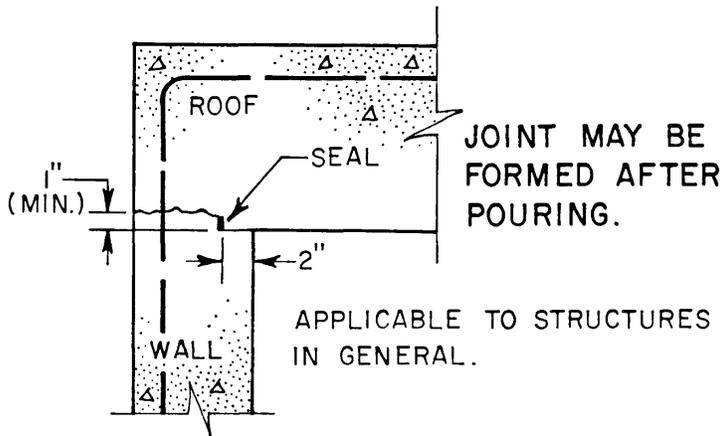


**NOTES:** DIMENSIONS ARE APPROXIMATE. SLOPED SURFACES APPROXIMATELY 45° FROM VERTICAL. JOINT SURFACE MUST BE FREE OF DEBRIS WHEN SECOND POUR IS MADE. USE 2 COATS OF "SIKA-SEAL" OR EQUAL FOR SEALING.

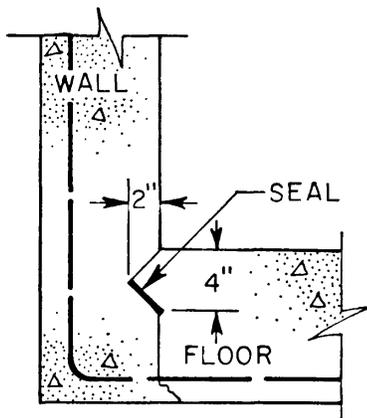

**WALLS POURED FIRST**

APPLICABLE WHERE WALLS ARE POURED AGAINST FIRM EARTH.

**FORM BEFORE POURING**

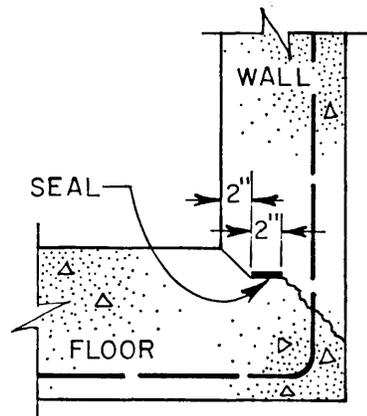

**FLOOR POURED FIRST**

APPLICABLE WHERE WALLS ARE TO BE DOUBLE FORMED.

**MAY BE FORMED AS POURED**