



Revision



SLAB BOX THREE PHASE TRANSFORMERS SB-4

UGS

REVISION: Included Unistrut


REVISION DATE: 11/02/09

APPROVED BY: *Cesar Ancheta*

APPROVED DATE: 11/10/09

PREPARED BY: JRS

CHECKED BY: CA

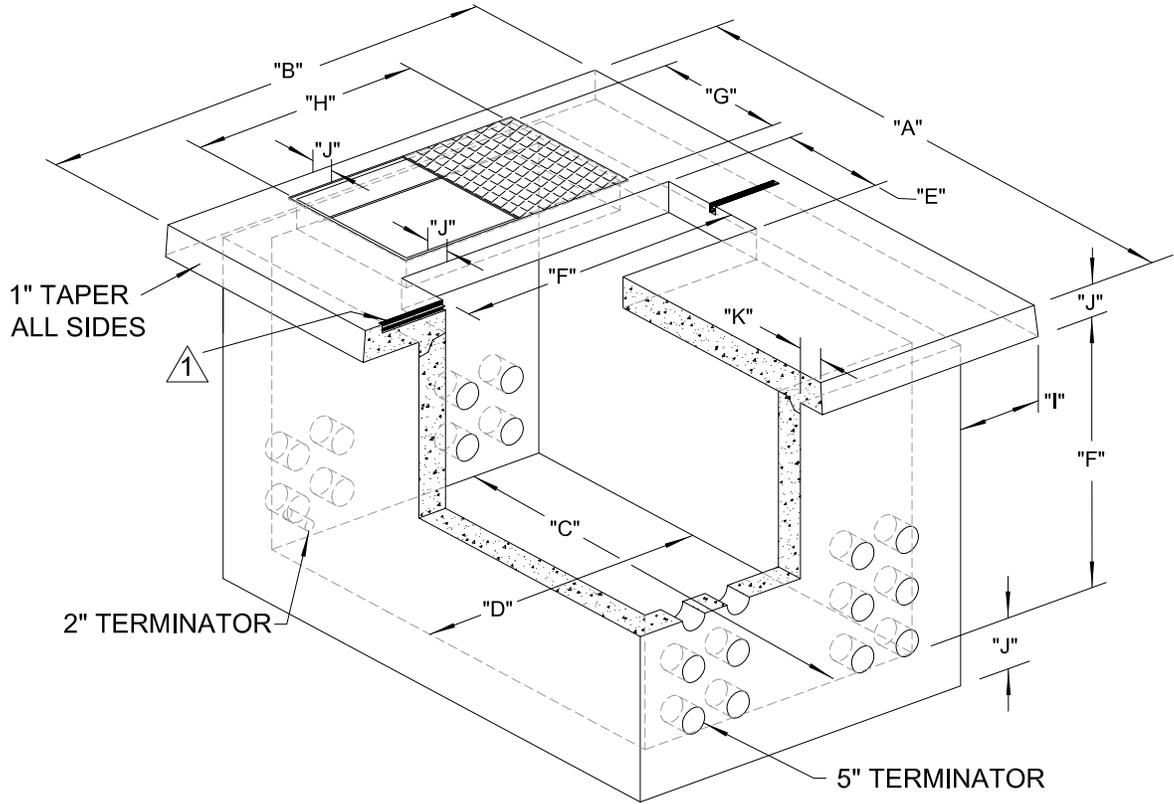

Item Number	Dimensions - Inches										
	Slab		Box		Transformer Opening		Access Opening		Overhang		
	A	B	C	D	E	F	G	H	I	J	K
SB-4	120	96	102	60	24	60	30	48	13	6	7.5

Notes:

1. See UGS-723 for installation of SB-4 Slab-boxes.
2. See UGS-010 for manufacturers of precast slab-boxes and catalog numbers.
3. All slab boxes shall be furnished with a polymer concrete cover with stainless steel, penta head cap screws for cover securing.
4. Polymer concrete covers are to be identified as "RIVERSIDE ELECTRIC" as per UGS-050.
5. Grade rings may be used when required. Maximum allowable are 12" grade rings.
6. Slab boxes shall have a precast unistrut to anchor the transformer cabinet.