

# SLAB BOX FOR THREE PHASE TRANSFORMERS SB-2, SB-3

UGS


Revision

DATE: 11/28/06

REVISION: Moved SB-4 to UGS-720

DATE: 12/11/06

APPROVAL: *Dave Redding*

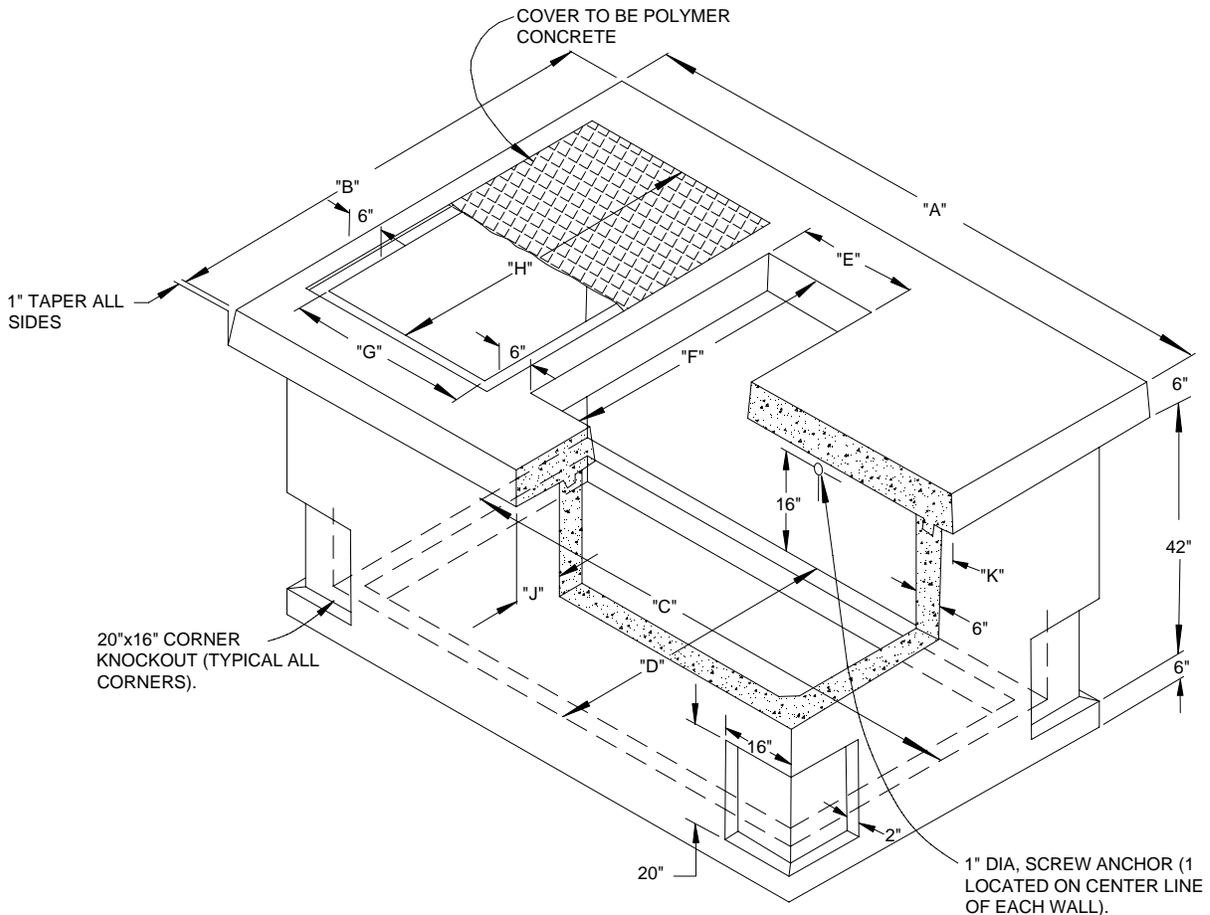

**Notes:**

1. See UGS-723 for installation of SB-4 Slab-boxes.
2. See UGS-010 for manufacturers of precast slab-boxes and catalog numbers.
3. All slab boxes shall be furnished with a polymer concrete cover with stainless steel, penta head cap screws for cover securing.
4. Polymer concrete covers are to be identified as "RIVERSIDE ELECTRIC" as per UGS-050.
5. Grade rings may be used when required. Maximum allowable are 12" grade rings.

ITEM NUMBER	DIMENSIONS-INCHES									
	SLAB		BOX		XFORMER OPENING		ACCESS OPENING		OVERHANG	
	A	B	C	D	E	F	G	H	J	K
SB-2	84	48	72	36	18	26	24	36	2.5	2.5
SB-3	96	72	84	48	18	48	30	48	8	2