



Revision



PEDESTAL JUNCTION CABINET ONE PIECE FIBERGLASS INSTALLATION

UGS

REVISION: Obsolete

REVISION DATE: 10/24/08


APPROVED BY: George Somoano

APPROVED DATE: 10/31/08

PREPARED BY: JRS

CHECKED BY: WEM

PEDESTAL JUNCTION CABINET (PJC)

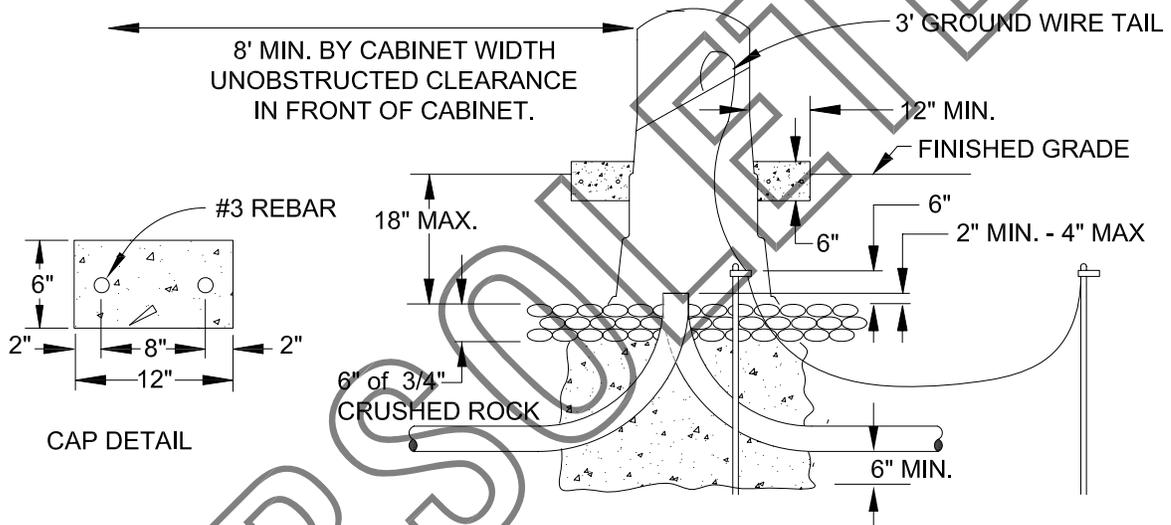

Notes:

1. Conduits to be aligned in a row per Department Inspector's direction.
2. Group bond wire per UGS-621.1, 722, or 723.
3. PJC is provided by the Department and installed by the Developer.
4. Conduit sweeps shall be encased with concrete (in accordance with UGS-015 mix 4001.)
5. A minimum 12" concrete cap shall be installed, (in accordance with UGS-015 mix 4001), by the developer around the PJC. See detail above.
6. No telecommunication conduit is to be installed in the PJC.
7. Barrier posts may be required at the discretion of the Department Inspector.
8. For Typical PJC locations, see UGS-730.
9. Typical, two ground rods - 5/8" x 8' copper shall be installed 6' minimum on center.




Revision



PEDESTAL JUNCTION CABINET ONE PIECE FIBERGLASS INSTALLATION

UGS

PEDESTAL JUNCTION CABINET DIMENSIONS

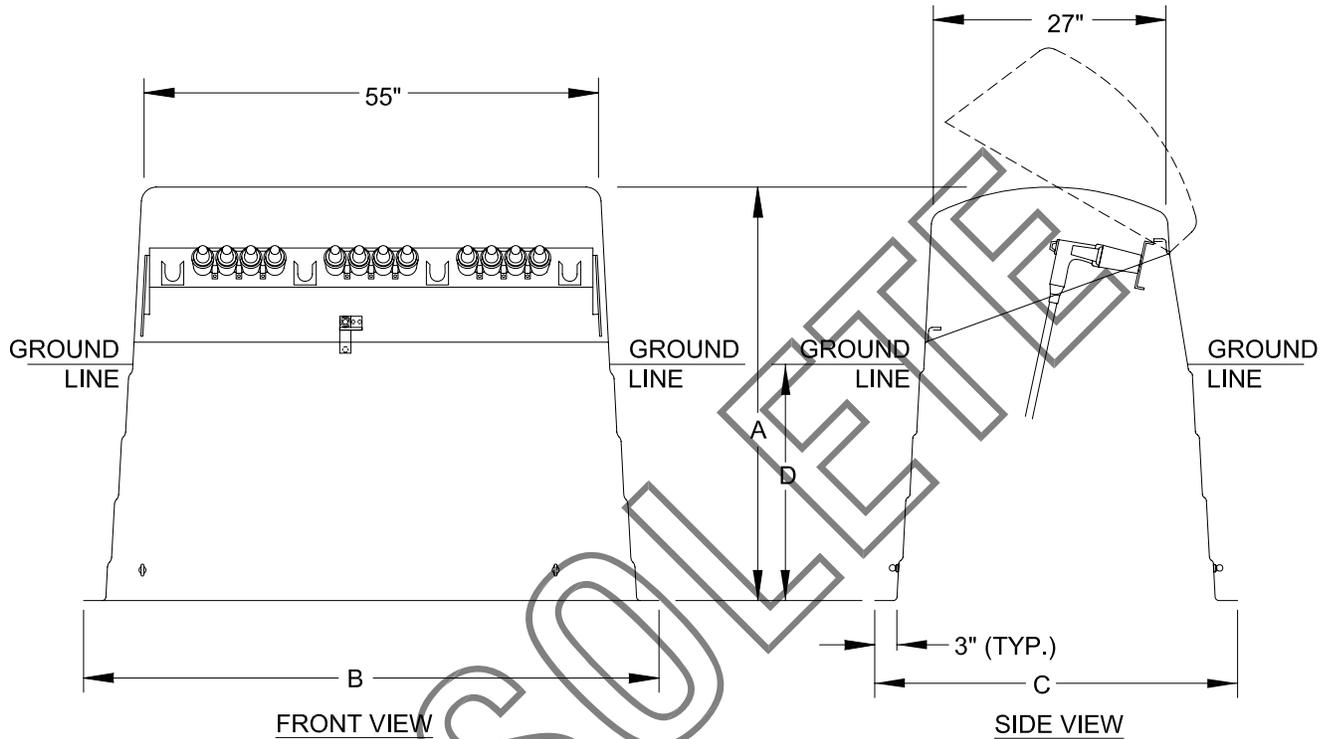

- A = 50"
- B = 69"
- C = 43"
- D = 18"

Notes:

1. Small dimension variations have been allowed for in the different manufactures

REVISION: Obsolete

REVISION DATE: 10/24/08

APPROVED BY: George Semeane

APPROVED DATE: 10/31/08

PREPARED BY: JRS

CHECKED BY: WEM