

See page 2 for quickset alternate.

Dimensions	A	B
Brooks	88 1/2"	5"
Quikset	89 1/2"	6"

Installation	Item No.	Quick set No.	Brooks No.	Quikset alt.
Parkway	BTE-2	BTV-4200-260	4200-260	BTV-4200
Sidewalk	BTE-3	BTV-4200Riv	4200-261	-----
Light Traffic	BTE-4	BTV-4200 D	4200-262	-----


Notes:

1. BTE to be furnished complete with shafts, top section, grate, beams (Lt. traffic only) baffle, and stainless steel bolts.
2. Baffle to be per UGS-733 or Cal-Formed, skirted (30" diameter X 20" high) H.D. Polyethylene (shown).
3. Grate for sidewalk installation shall have flatted expanded metal (1/2" No. 13 ga) top covering welded in place prior to galvanizing.
4. Light Traffic units include 5" thick concrete base section.
5. See UGS-735 for parkway installation requirements and UGS-736 for light traffic installation requirements.
6. All B.T.E.'s shall be furnished with stainless steel, penta head cap screws for cover securing.

DRAWN:	UNDERGROUND STRUCTURES STANDARDS	UGS-734 PAGE 1 OF 2
CHECKED:	PRECAST	
APPROVED:	BURIED TRANSFORMER ENCLOSURE	
DATE: 8/4/1998	(BTE)	

# PRECAST BURIED TRANSFORMER ENCLOSURE (BTE)

RIVERSIDE PUBLIC UTILITIES DEPT. - UNDERGROUND STRUCTURES

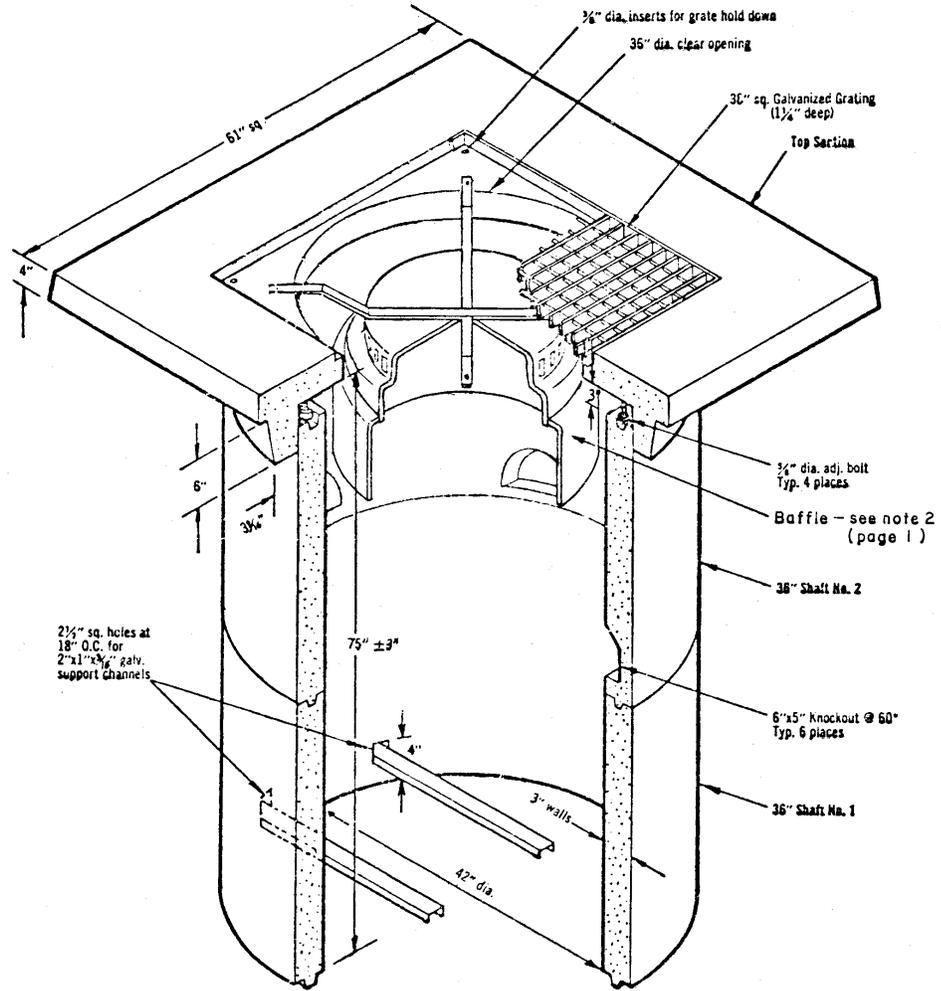

QUIKSET BTV-4200

See page 1 for notes and application.