

SWITCHGEAR FIBERGLASS BOX PAD REQUIREMENTS (FOR SERIES 9,10 & 11 SWITCHES)

REVISION: Updated Format & Relocated From UGS-011


CHECKED BY
 (ENGINEERING): JRS

DATE: 12/03/18

CHECKED BY
 (FIELD): JH

APPROVED BY: *Stephen E. Saford*

PREPARED
 BY: SJR

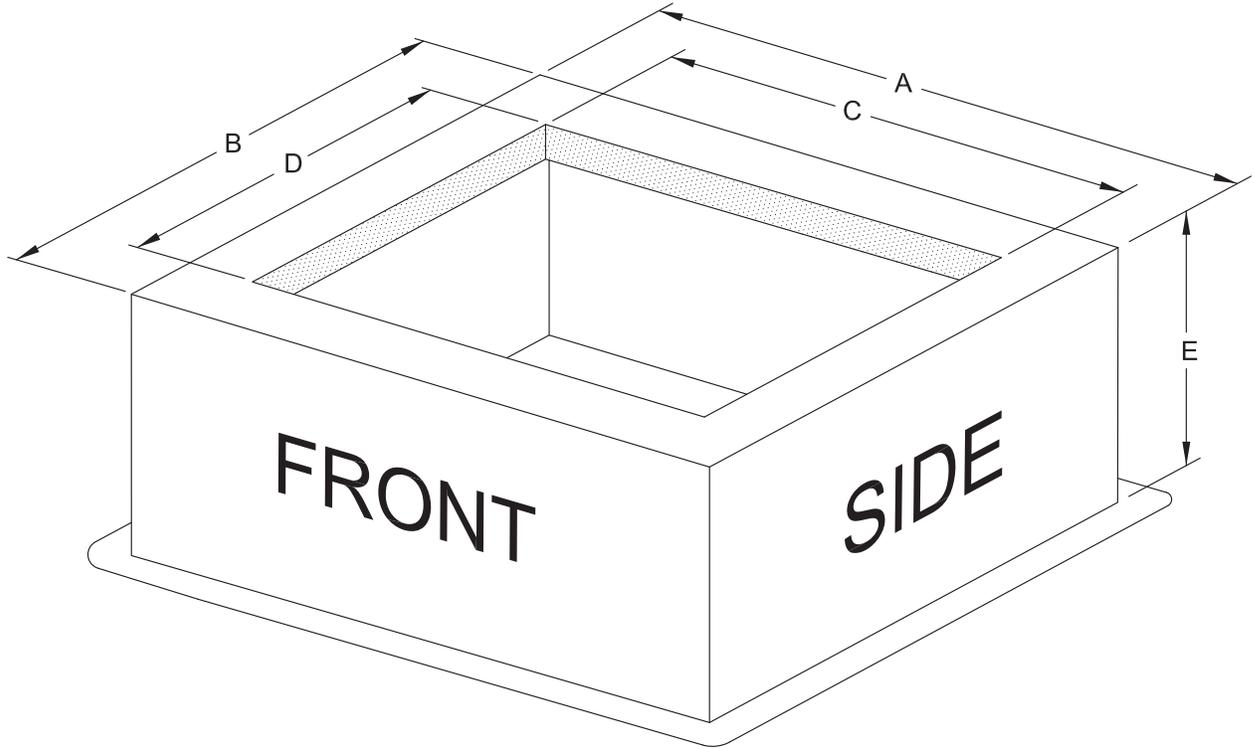

Fiberglass Switch Box for Series 9,10 & 11 Switches							
Manufacturer	Manufacturer Catalog No.	Dimensions (Inches)					RPU Stock No.
		A	B	C	D	E	
New Basis	7476/36	76"	74"	64"	62"	36"	25276
Electrimold	EFBS-747636-6264-402	76"	74"	64"	62"	36"	



Notes:

1. Acceptable fiberglass box pads are listed above.
2. See UGS-660 for installation details.
3. The compartment of the switchgear to be to the front to rear of the box pad.
4. The termination sections of the switchgear is to be placed above dimension "A" surface.