

FIBERGLASS PEDESTAL JUNCTION CABINET BOX PAD REQUIREMENTS (FOR SINGLE PHASE PJC CABINETS)

REVISION: New Underground Standard


CHECKED BY
 (ENGINEERING): JRS

DATE: 12/03/18

CHECKED BY
 (FIELD): JH

PREPARED
 BY: SJR

APPROVED BY: *Stephen E. Saford*

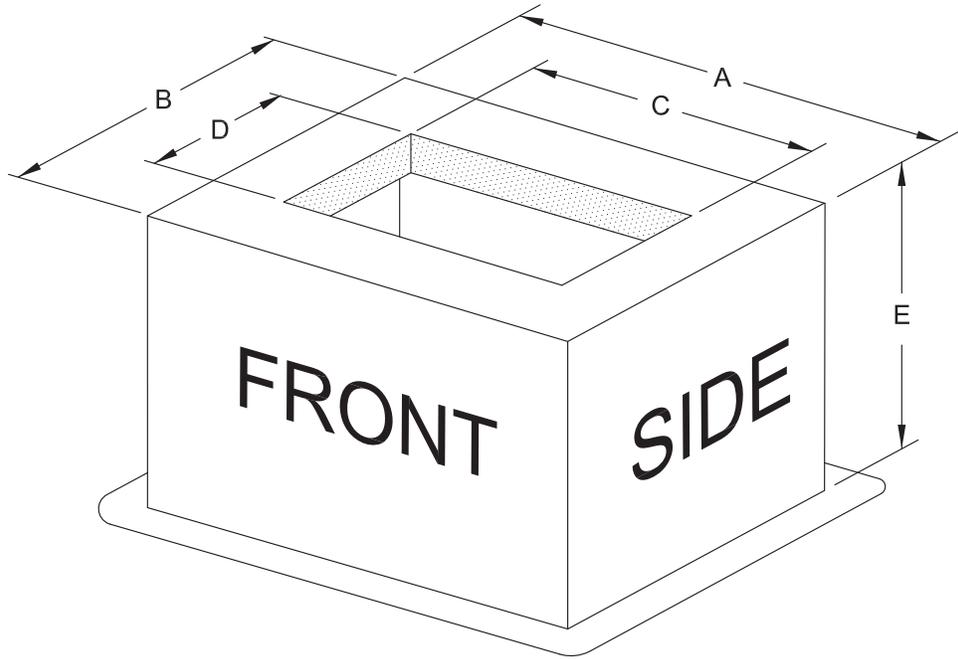

Single Phase Fiberglass Pedestal Junction Cabinet Box Pad Requirements								
Manufacturer	Manufacturer Catalog No.	Dimensions (Inches)						RPU Stock No
		Phase	A	B	C	D	E	
Electrimold	EFBG-183024-1022-300	1	30"	18"	24"	12"	24"	25297
Durham	G8243018F							
New Basis	1830/24							

Notes:

1. Acceptable fiberglass box pads are listed above.
2. See UGS-731 for installation details.
3. The termination sections of the switchgear is to be placed above dimension "A" surface.

