

# FIBERGLASS PEDESTAL JUNCTION CABINET BOX PAD REQUIREMENTS (FOR THREE PHASE PJC CABINETS)

REVISION: New Underground Standard


CHECKED BY  
 (ENGINEERING): JRS

DATE: 12/03/18

CHECKED BY  
 (FIELD): JH

PREPARED  
 BY: SJR

APPROVED BY: *Stephen E. Saford*

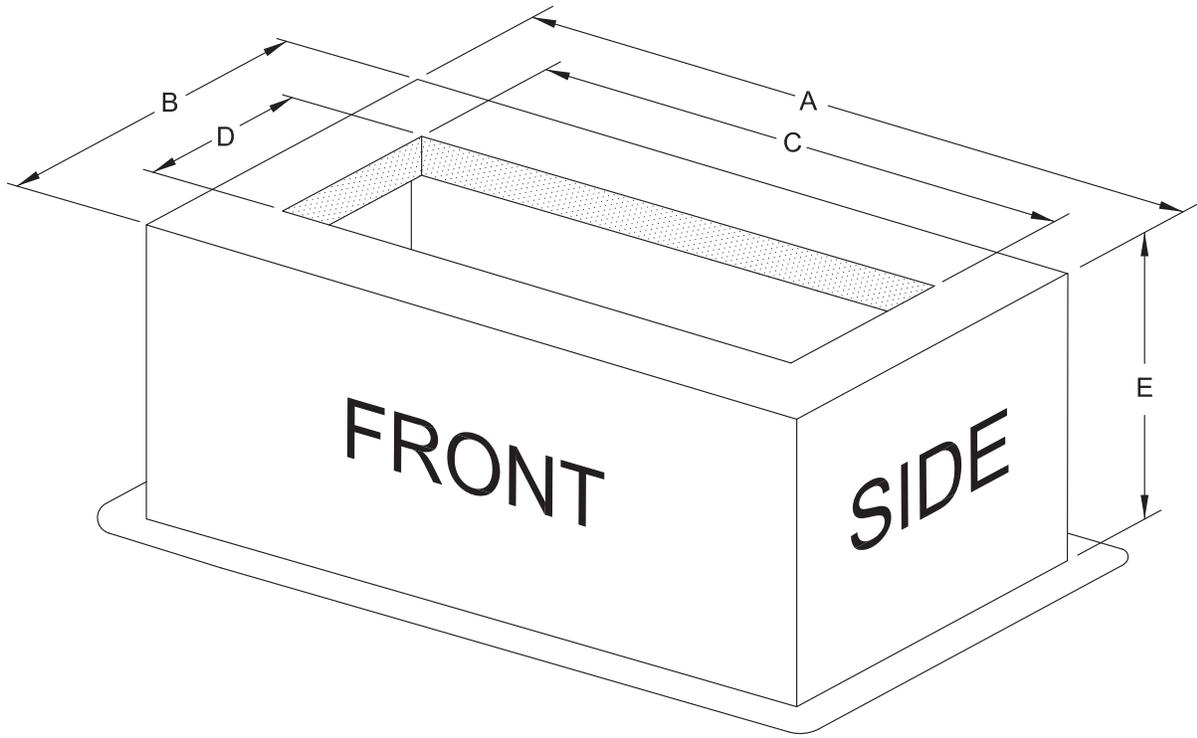

| Three Phase Fiberglass Pedestal Junction Cabinet Box Pad Requirements |                          |                     |     |     |     |     |     |              |
|---|--------------------------|---------------------|-----|-----|-----|-----|-----|--------------|
| Manufacturer  | Manufacturer Catalog No. | Dimensions (Inches) |     |     |     |     |     | RPU Stock No |
|   |                          | Phase               | A   | B   | C   | D   | E   |              |
| Electrimold   | EFBG-236724-1858-300     | 3                   | 66" | 22" | 60" | 16" | 24" | 25292        |
| Durham  | GS246622F                |                     |     |     |     |     |     |              |
| New Basis   | 2266/24                  |                     |     |     |     |     |     |              |



**Notes:**

1. Acceptable fiberglass box pads are listed above.
2. See UGS-731 for installation details.
3. The termination sections of the switchgear is to be placed above dimension "A" surface.