

PEDESTAL JUNCTION CABINET PLACEMENT

REVISION: Updated Format.





CHECKED BY
 (ENGINEERING): JRS

DATE: 12/03/18

CHECKED BY
 (FIELD): JH

APPROVED BY: *Stephen E. Saford*

PREPARED
 BY: SJR

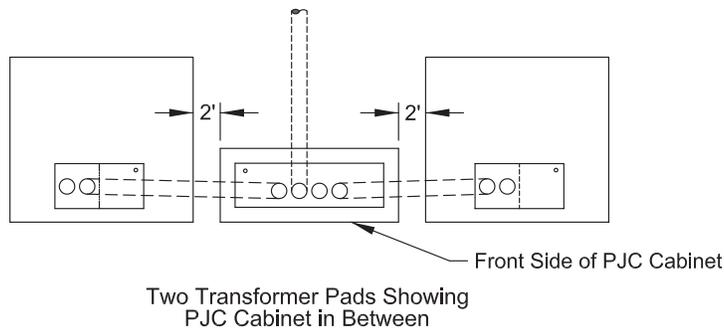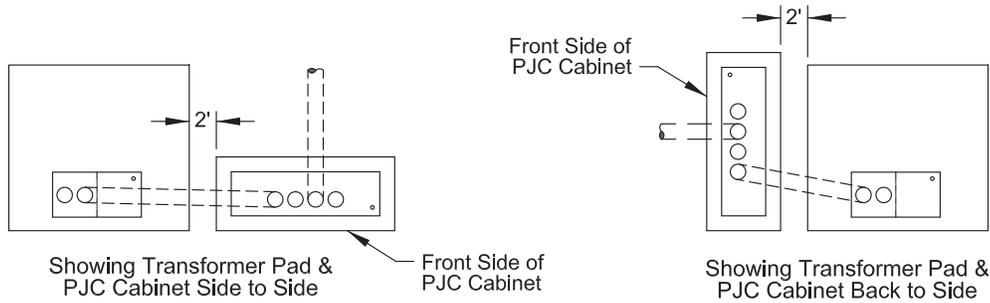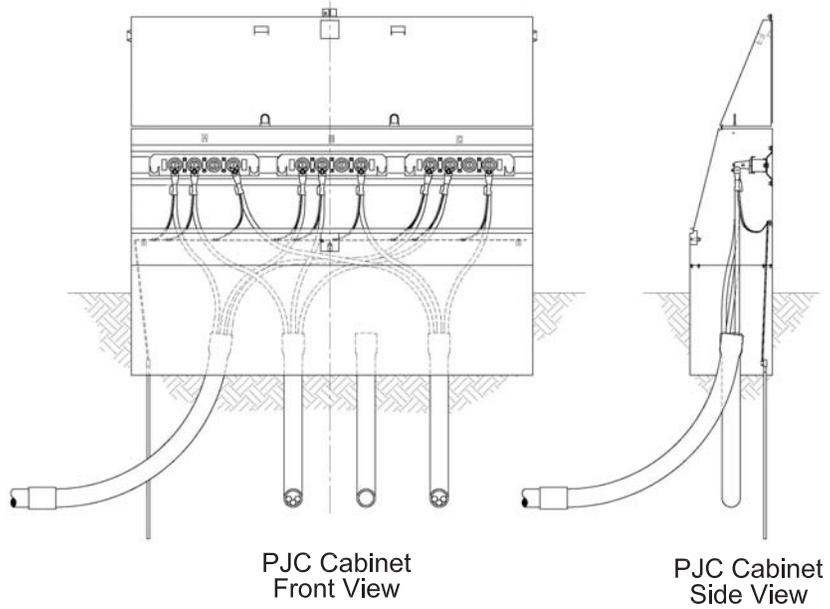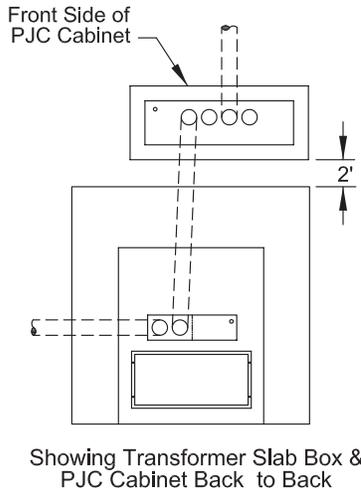

Notes:

1. No Telecommunication or Fiber Optic Components shall be installed in the PJC Cabinet.
2. See UGS-011.3 for PJC Fiberglass Sleeve Dimensions & Ordering Information.
3. See UGS-730.1 for Installation of PJC Cabinet on Fiberglass Sleeve.
4. See UGS-730.2 for PJC Cabinet Dimensions & Details.
5. Barrier Posts may be required at the discretion of RPU Electric Inspector; See UGS-290 for Installation Requirements
6. Two Ground Rods spaced 6' apart shall be installed for each structure/equipment; See UGS-730.1
7. RPU Distribution System is designed for Loop Feed Infrastructure.

MAINTENANCE ONLY
 NOT FOR NEW CONSTRUCTION