



WATER SERVICE CONNECTION, NOT LIMITED TO HYDRANT CONNECTIONS.

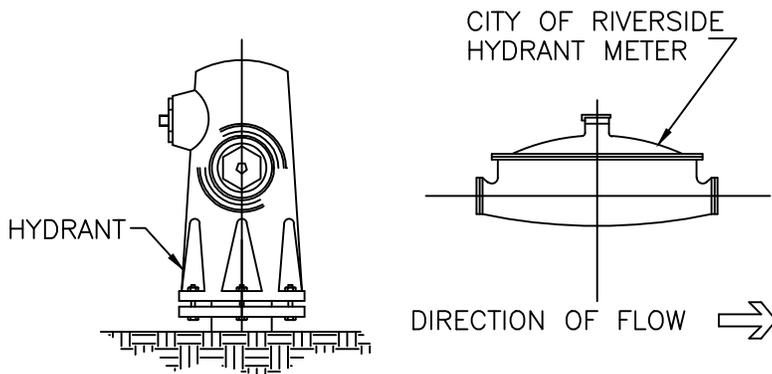

REDUCED PRESSURE BACKFLOW
DEVICE FOR DIRECT CONNECTIONS

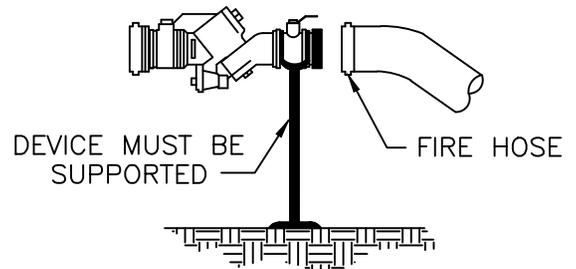

GUIDELINES:


1. AN AIR GAP IS REQUIRED AT SERVICE CONNECTION WHEN:
 - a) A REDUCED PRESSURE BACKFLOW DEVICE (RP) IS NOT AVAILABLE.
 - b) THE POTABLE WATER SUPPLY IS USED TO SUPPLEMENT A NON-POTABLE OR RECYCLED WATER SUPPLY.
2. A REDUCED PRESSURE BACKFLOW DEVICE (RP) IS REQUIRED WHEN:
 - a) AN AIR GAP IS NOT PRACTICAL.
 - b) CUSTOMER'S LENGTH OF HOSE EXCEEDS 50'.
 - c) WATER IS APPLIED DIRECTLY VIA HOSE.
 - d) THERE IS ANY PROCESS OR EQUIPMENT DIRECTLY SUPPLIED VIA CONNECTION.
 - e) THERE IS ANY RIDGED PIPING OR VALVE DOWNSTREAM OF CONNECTION.

CONNECTION IS SUBJECT TO APPROVAL OF THE PROGRAM SPECIALIST. CONNECTION AND BACKFLOW DEVICE MUST BE INSPECTED IMMEDIATELY AFTER INSTALLATION. TO SCHEDULE AN APPOINTMENT, CALL (951) 351-6320 OR (951) 351-6282.

TEMPORARY CONNECTION METER CONTACTS

TELEPHONE NUMBERS:

- (951) 826-5285 - WATER ENGINEERING
- (951) 351-6320 - WATER OPERATIONS/BACKFLOW
- (951) 351-6350 - WATER MAINTENANCE/METER SHOP
- (951) 782-0330 - CUSTOMER SERVICE

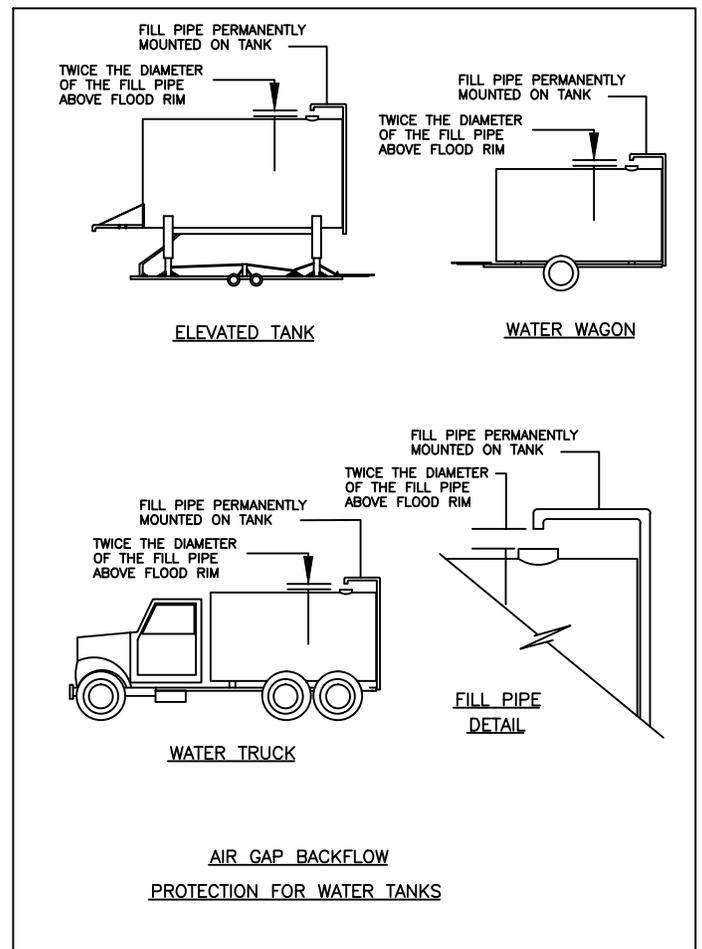

WATER DISTRIBUTION & TRANSMISSION
PIPELINE CONSTRUCTION METHODS

TEMPORARY, EMERGENCY, OR CONSTRUCTION
WATER SERVICE / BACKFLOW PROTECTION