


PRECAST PULL BOXES INTERCEPTING

REVISION: Replaces Structure Details in UGS-301, UGS-302, UGS-303, & UGS-304; Created / Updated Table, Details & Notes

CHECKED BY (ENGINEERING): SJ DATE: 02/12/15

CHECKED BY (FIELD): DM
 PREPARED BY: SJR
 APPROVED BY: *Chen Mejia*

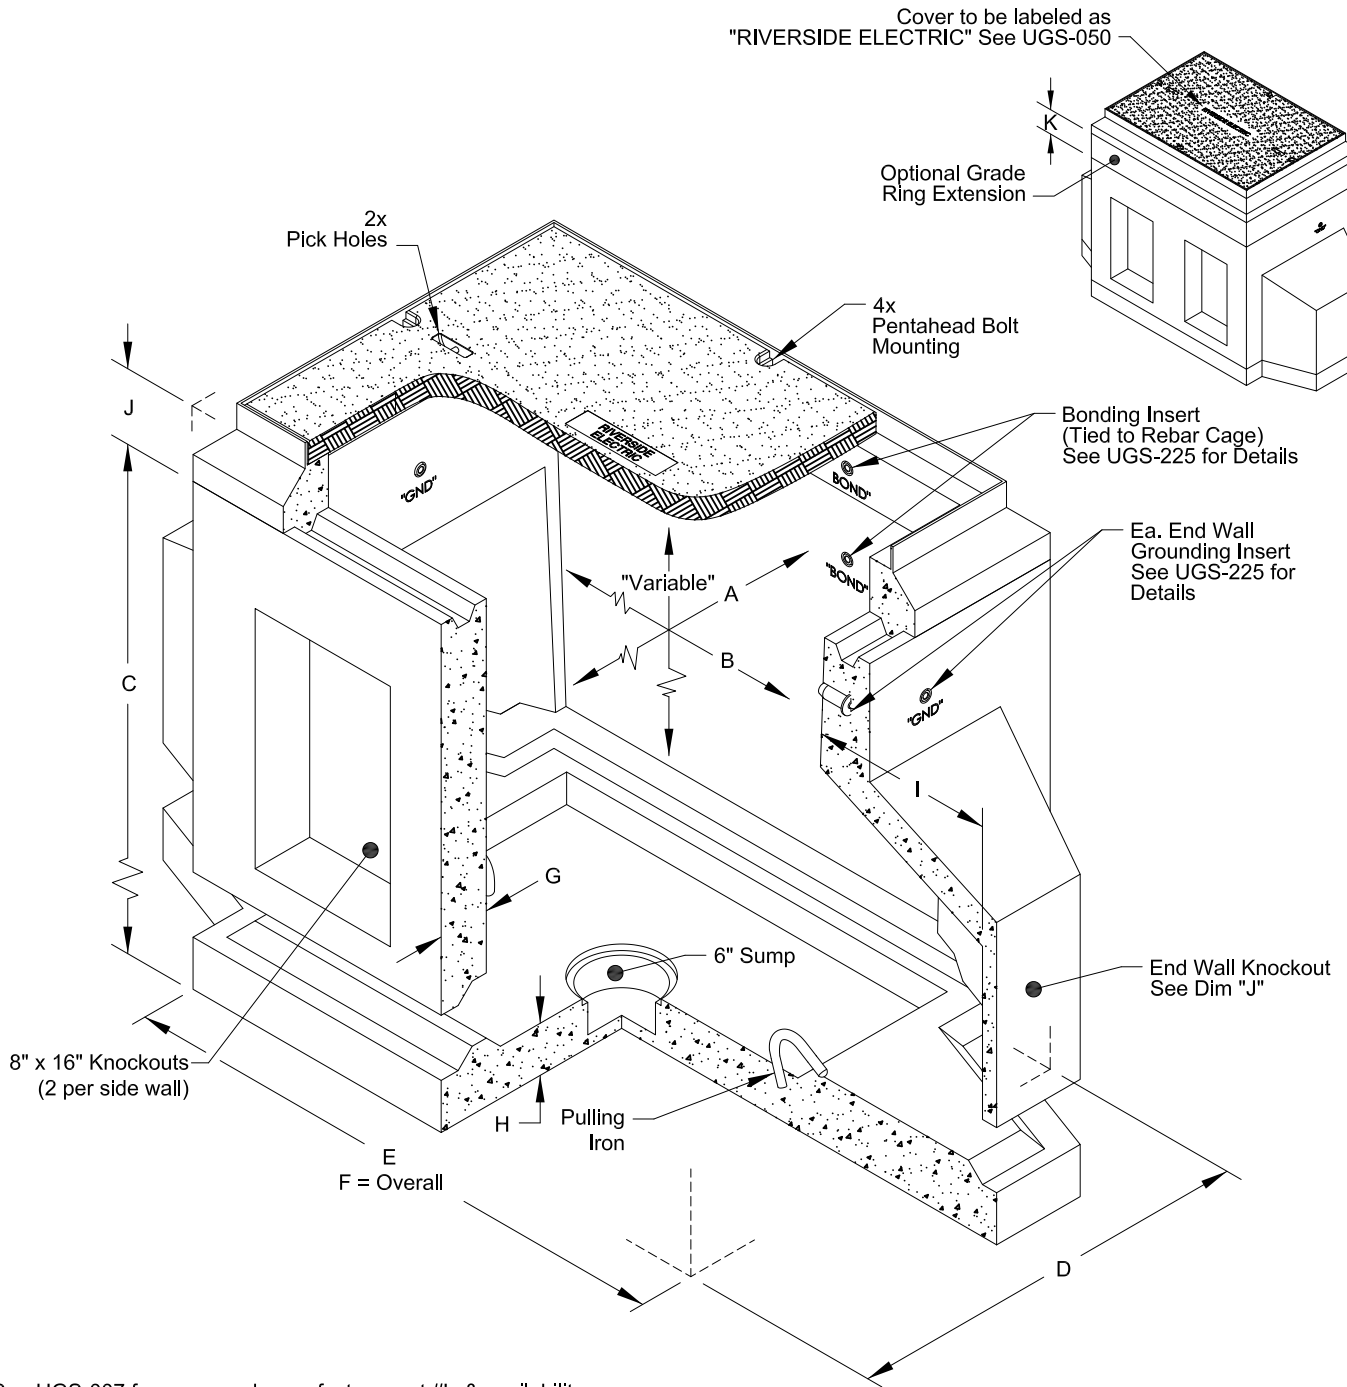

See UGS-007 for approved manufacture part #'s & availability.
 - Parkway cover shown above

Line Item	Pull Box (Type)	Pull Box Size	Typical Pull Box Dimensions											
			A	B	C	D	E	F	G	H	I	J	K	L
5	PI-1	2' x 3'	24"	36"	35"	32"	44"	67"	4"	5"	14"	11" x 11"	6" / 12"	6" / 12"
6	PI-2													
13	PI-3	2'-6" x 4'	30"	48"	41"	40"	58"	75"	5"	5"	12"	26" x 26"	6" / 12"	6" / 12"
14	PI-4													
21	PI-7	3' x 5'	36"	60"	48"	44"	68"	87"	4"	6"	12"	26" x 26"	6" / 12"	6" / 12"
22	PI-8													

Notes:
 1. To achieve proper grade or depth 6", 9" or 12" grade rings may be required.