


**NOTES:**

- 1.) NUMBER AND POSITION OF GUARD POSTS AS SPECIFIED ON PLANS.
- 2.) REFER TO "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION", SEC. 210 AND SEC. 310.



**WATER DISTRIBUTION & TRANSMISSION  
PIPELINE CONSTRUCTION METHODS**

**4" DIA. GUARD POST INSTALLATION**

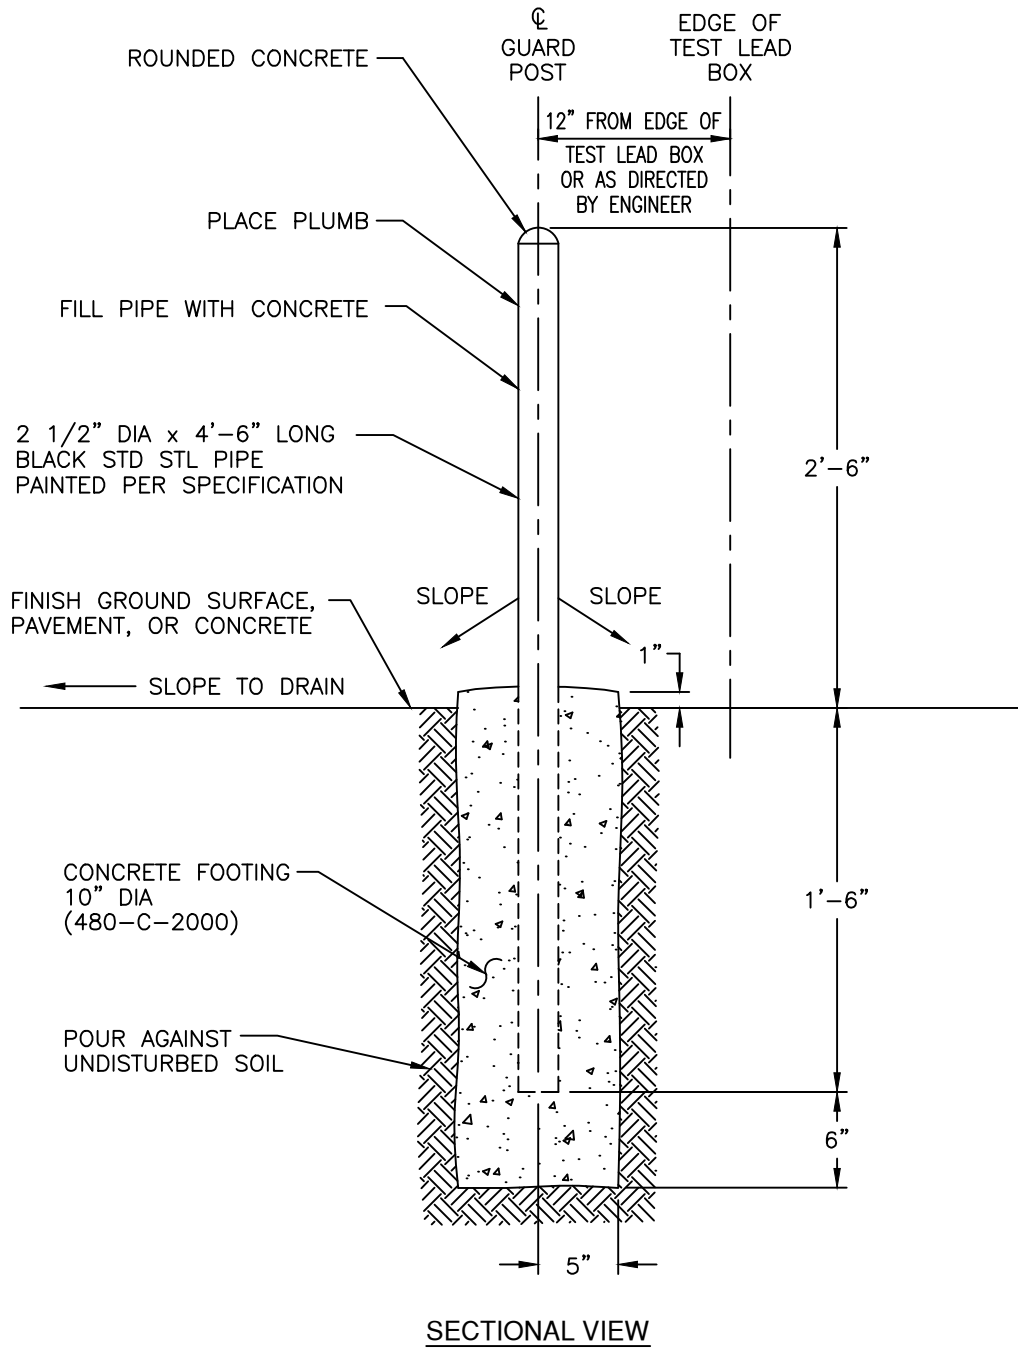

**NOTES:**

- 1.) NUMBER AND POSITION OF GUARD POSTS AS SPECIFIED ON PLANS.
- 2.) REFER TO "STANDARD SPECIFICATIONS PUBLIC WORKS CONSTRUCTION", SEC 210 AND 310.



WATER DISTRIBUTION & TRANSMISSION  
PIPELINE CONSTRUCTION METHODS

2.5" DIA. GUARD POST INSTALLATION